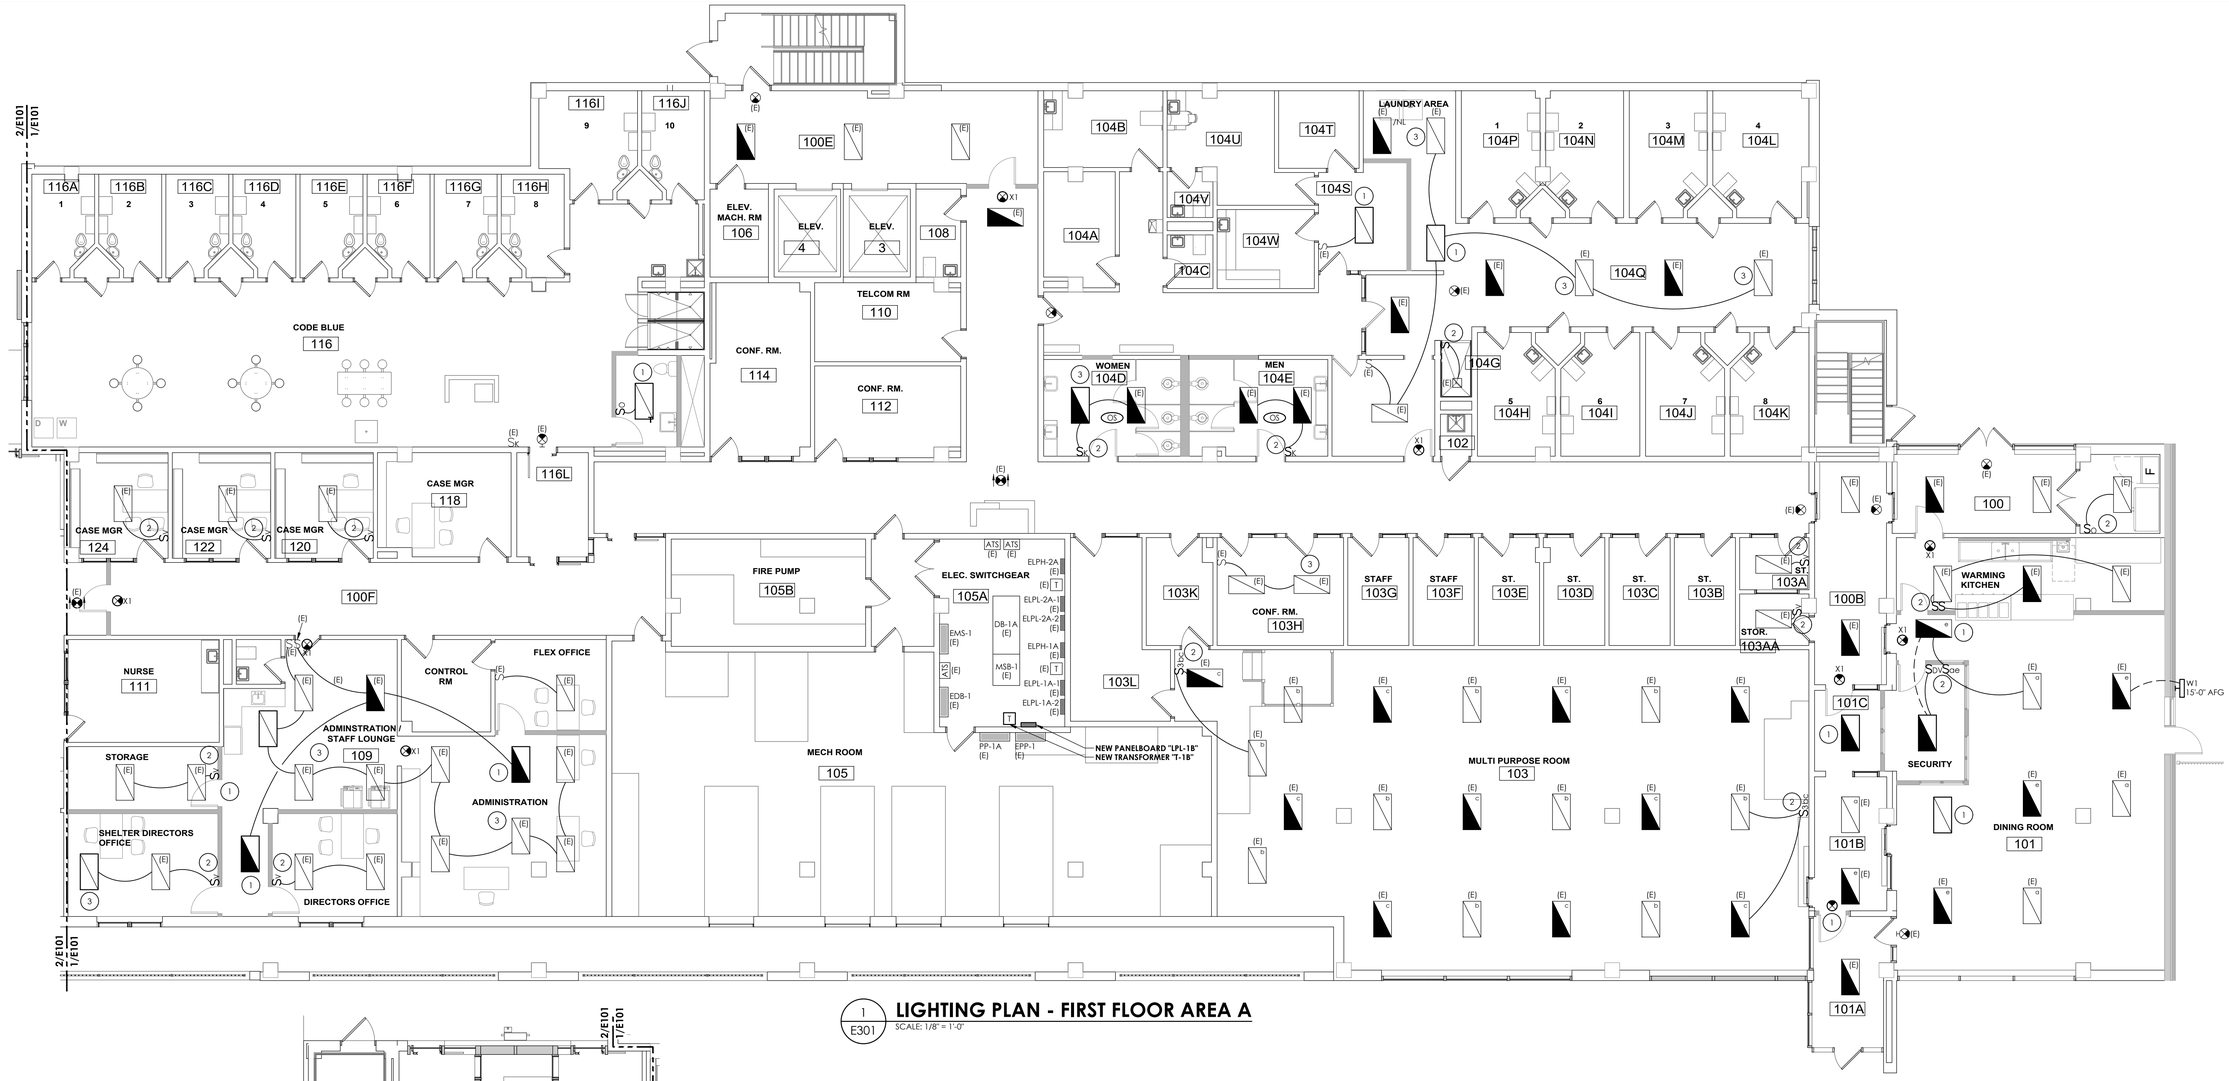

1 E301 **LIGHTING PLAN - FIRST FLOOR AREA A**

SCALE: 1/8" = 1'-0"

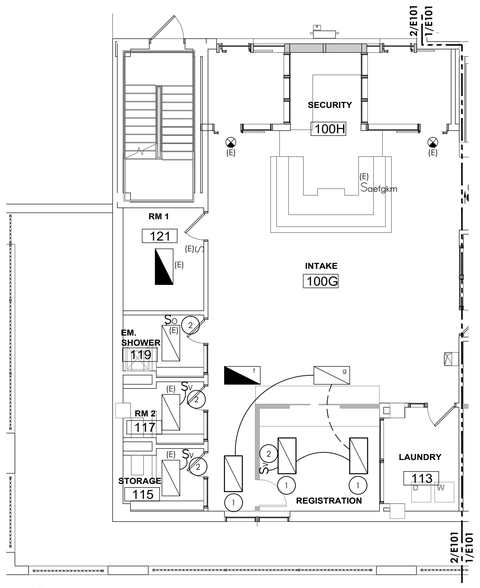

2 E301 **LIGHTING PLAN - FIRST FLOOR AREA B**

SCALE: 1/8" = 1'-0"

KEY NOTES:

1. REINSTALL LIGHT FIXTURE SALVAGED DURING DEMOLITION. REWORK AND EXTEND EXISTING CIRCUITING AS REQUIRED TO NEW LOCATION.
2. PROVIDE NEW SWITCH AND WIRE TO CONTROL EXISTING LIGHT FIXTURE(S) INDICATED. REWORK AND EXTEND EXISTING CIRCUITING AS REQUIRED TO ACCOMMODATE NEW SWITCHING.
3. REWORK AND EXTEND EXISTING NORMAL AND/OR EMERGENCY CIRCUIT TO EXISTING LIGHT FIXTURE AND/OR SWITCHING AS INDICATED WITHIN AREA.

GENERAL NOTES:

A. EQUIPMENT AND DEVICES LABELED AS "(E)" ARE EXISTING AND ARE SHOWN FOR REFERENCE ONLY. ALL OF THESE EQUIPMENT AND DEVICES SHALL REMAIN OPERATIONAL FOLLOWING CONSTRUCTION.

B. REFER TO LUMINAIRE SCHEDULE ON DRAWING E900 FOR FIXTURE DESIGNATION, TYPES, DESCRIPTIONS, AND SPECIFICATIONS.

C. ALL HALF SHADED LUMINAIRES AND LUMINAIRES DESIGNATED WITH "/EM" SHALL INDICATE EMERGENCY LUMINAIRES.

D. LUMINAIRES DESIGNATED WITH "/NL" INDICATE NIGHTLIGHTS AND SHALL BE UNSWITCHED AND REMAIN ON AT ALL TIMES.

E. NEW LIGHTING CONTROLS SHOWN (OCCUPANCY SENSORS, VACANCY SENSORS, PHOTOCELLS, SWITCHES, DIMMERS, ETC.) SHALL COMPATIBLE WITH LUMINAIRES SERVED. PROVIDE ALL ASSOCIATED CONTROL UNITS, POWER PACKS, WIRING, AND ACCESSORIES REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM.

F. CONNECT ALL LOW VOLTAGE CONTROL UNITS AND POWER PACKS TO ASSOCIATED ROOM LIGHTING BRANCH CIRCUIT AHEAD OF LOCAL AREA SWITCHING.

G. UNLESS NOTED OTHERWISE, IN EACH ROOM/AREA SHOWN ON THE PLAN, WIRE NEW LIGHT FIXTURES TO EXISTING LIGHTING BRANCH CIRCUITING LEFT FROM DEMOLITION. REWORK AND EXTEND EXISTING CIRCUITING AS REQUIRED TO SERVE NEW FIXTURE AND CONTROL LAYOUT.

H. CONNECT EXIT SIGNS TO EXISTING EXIT SIGN LIGHTING BRANCH CIRCUITING WITHIN AREA.

I. CONTRACTOR SHALL BE RESPONSIBLE TO CLEAN ALL EXISTING LUMINAIRES AFTER SUBSTANTIAL COMPLETION PRIOR TO OWNER OCCUPANCY.

J. CONTRACTOR SHALL PROVIDE ALL EXISTING INTERIOR AND EXTERIOR LUMINAIRES IN WORKING CONDITION AT SUBSTANTIAL COMPLETION. FOR BIDDING PURPOSES CONTRACTOR SHALL ASSUME RELAMPING OF (25)F32T8.

Consultant

CPL | Architecture Engineering Planning

RTEXT: file open error

CPLteam.com

NY ENGINEERING FIRM CERTIFICATE #018330

DC TEMPORARY HOMELESS SHELTER
RFB-DCB-01-24

150 N HAMILTON STREET
POUGHKEEPSIE, NY 12601

Submissions

No.	Description	Date

© TINKELMAN ARCHITECTURE PLLC | 2023
ALL RIGHTS RESERVED-COPY OR REPRODUCTION OF THIS DRAWING OR ANY PORTION THEREOF IS PROHIBITED WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. UNAUTHORIZED ALTERATION OR ADDITION TO A DRAWING BEARING THE SEAL OF A LICENSED ARCHITECT IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

TINKELMAN ARCHITECTURE

33 Arlington Avenue, 2nd Floor, Poughkeepsie, NY
845.473.0200 | view our work at tinkarch.com

Professional Seal

STATE OF NEW YORK · ANTHONY R. MIGNOSTI · No. 16GE 0153 · LICENSED PROFESSIONAL ENGINEER

LICENSE EXPIRATION DATE: 05/31/2024

LIGHTING PLAN - FIRST FLOOR

Proj. No.	C2349.00
Date	01/18/2024

E301