



AIA[®] Document G710™ – 2017

Architect's Supplemental Instructions

PROJECT: *(name and address)*
57-21113-00 - Rebid Dutchess Stadium
New Left Field Clubhouse, Seating Bowl,
& Restroom Building

CONTRACT INFORMATION:
Contract For:
Date:

ASI INFORMATION:
ASI Number: 002
Date: April 27, 2023

OWNER: *(name and address)*
Dutchess County
22 Market St
Poughkeepsie, NY 12601

ARCHITECT: *(name and address)*
DLR Group inc.,
33 East 33rd Street Suite 401
New York, NY 10016

CONTRACTOR: *(name and address)*
Piazza, Inc.
3 W Stevens Ave
Hawthorne, NY 10532

The Contractor shall carry out the Work in accordance with the following supplemental instructions without change in Contract Sum or Contract Time. Proceeding with the Work in accordance with these instructions indicates your acknowledgment that there will be no change in the Contract Sum or Contract Time.
(Insert a detailed description of the Architect's supplemental instructions and, if applicable, attach or reference specific exhibits.)

This ASI is being issued to integrate structural revisions resulting from RFIs received to date.

Attachments
Drawing(s): S1.1.ii, S4.2.ii, and S5.1.ii

ISSUED BY THE ARCHITECT:

DLR Group inc., a New York corporation
ARCHITECT *(Firm name)*




SIGNATURE

Bob Carlson, AIA, LEED AP,
Principal
PRINTED NAME AND TITLE

April 27, 2023
DATE

FOUNDATION NOTES

1. FINISHED FLOOR ELEVATION VARIES PER PLAN. 100'-0" EQUAL TO SURVEY ELEVATION 152'-0" PER CIVIL DOCUMENTS.
2. REFER TO ARCHITECTURAL DRAWINGS FOR OVERALL BUILDING GEOMETRY, WALL LOCATIONS, AND ADDITIONAL PARTITION WALL REQUIREMENTS. CONFIRM WALL OPENINGS, TOP OF WALL ELEVATIONS AND BRICK LEDGE ELEVATIONS WITH ARCHITECTURAL DRAWINGS.
3. SEE ARCHITECTURAL DRAWINGS FOR LOCATION OF SLOPED, RAISED, DEPRESSED SLABS AND DRAINS.
4. REFER TO SPECIFICATIONS FOR ALL SUBGRADE PREPARATION REQUIREMENTS. REFER TO GENERAL NOTES FOR BACKFILL AND TEMPORARY SHORING REQUIREMENTS.
5. COORDINATE ALL PENETRATIONS THRU FOUNDATIONS WITH MEP DRAWINGS. REFERENCE TYPICAL FOUNDATION DETAILS FOR SLEEVE DETAILING.
6. ALL EXTERIOR EXPOSED STEEL (IN UNCONDITIONED SPACE) SHALL BE HOT DIP GALVANIZED.

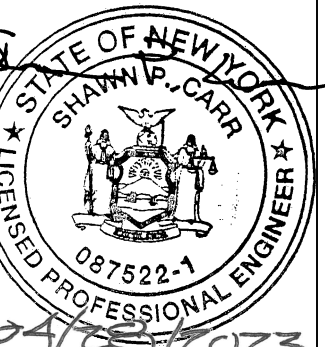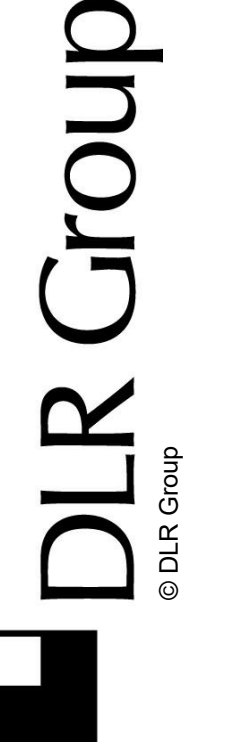

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed Design Professional, to alter an item in any way.


REBID DUTCHESS STADIUM NEW LEFT FIELD CLUBHOUSE, SEATING BOWL, & RESTROOM BUILDING
 OWNER: DUTCHESS COUNTY, 22 MARKET STREET POUGHKEEPSIE, NY 12601
 1500 ROUTE 90, FISHKILL, NY 12590

BID SET
 11.04.22

REVISIONS		
1	CONSTRUCTION DOCS	03.06.23
2	ASB 051	04.07.23
3	ASB 002	04.27.23


57-21113-00
 FOUNDATION PLAN

S1.1.ii

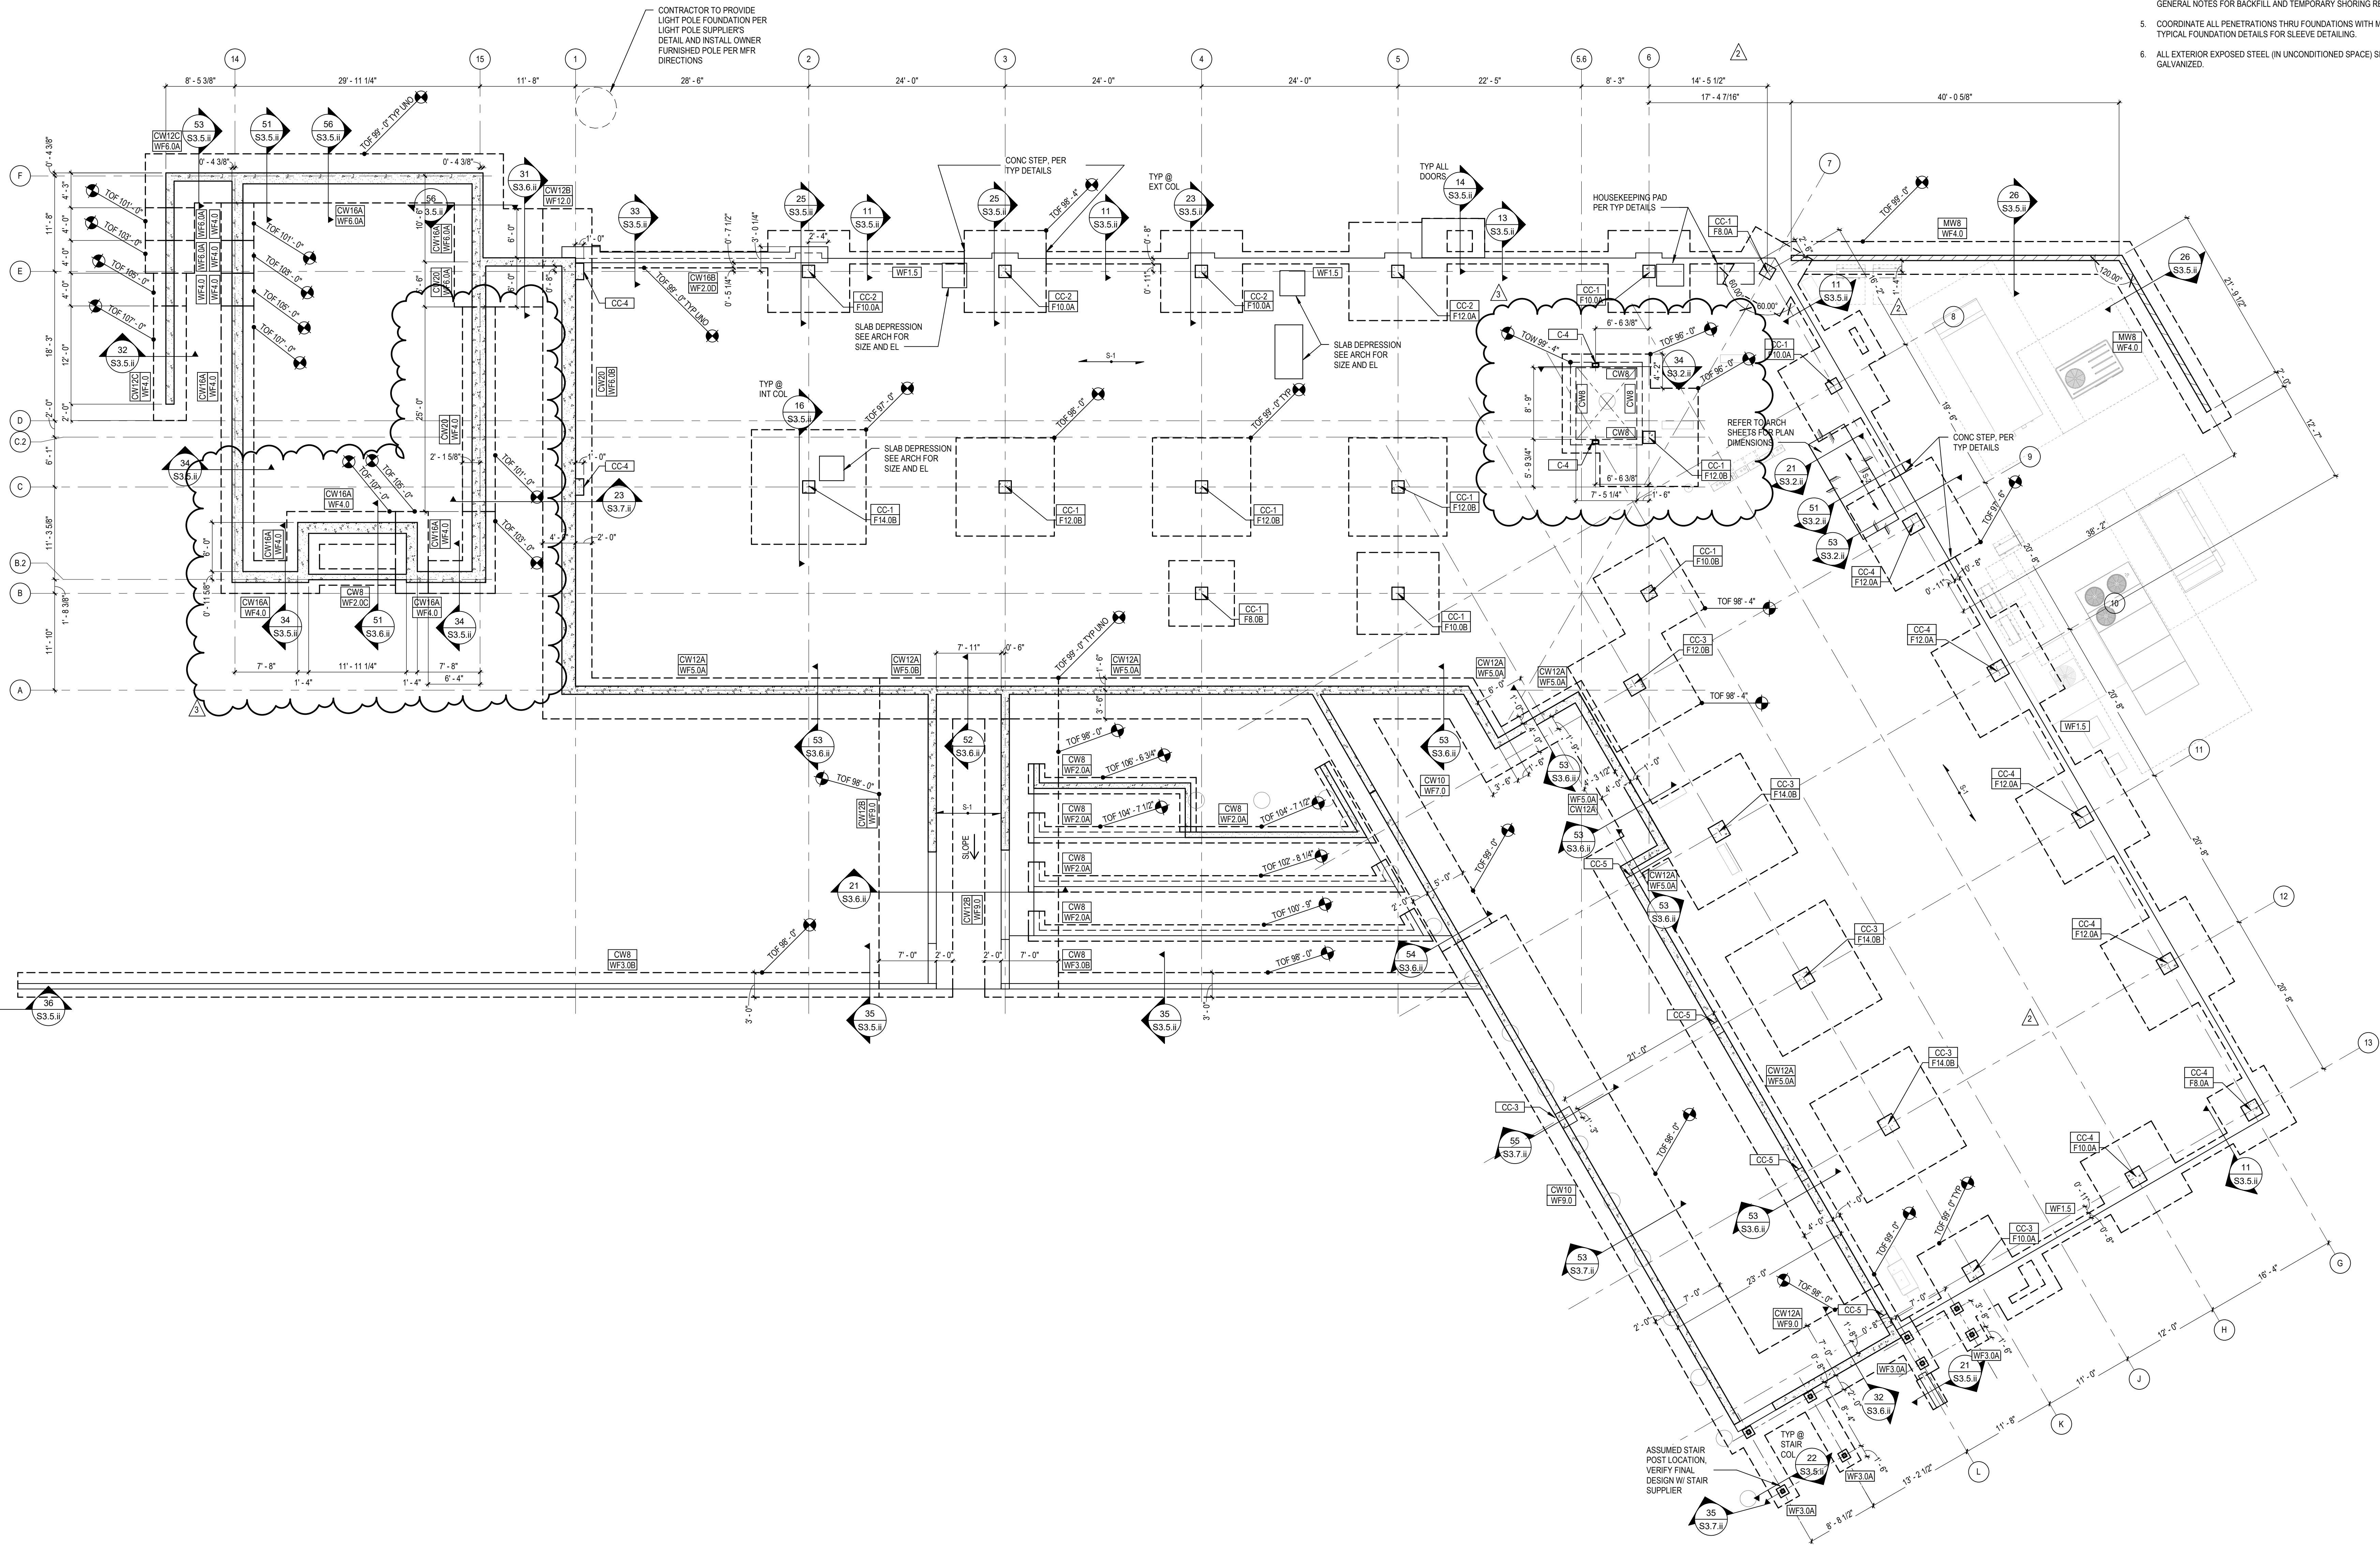


FOUNDATION PLAN, LEVEL 01
 SCALE: 1/8" = 1'-0"


B:\360\57-21113-00_Dutchess Stadium\PH\57-21113-00_Dutchess Stadium_Plan_57_2020.rvt
 4/27/2023 12:56:27 PM

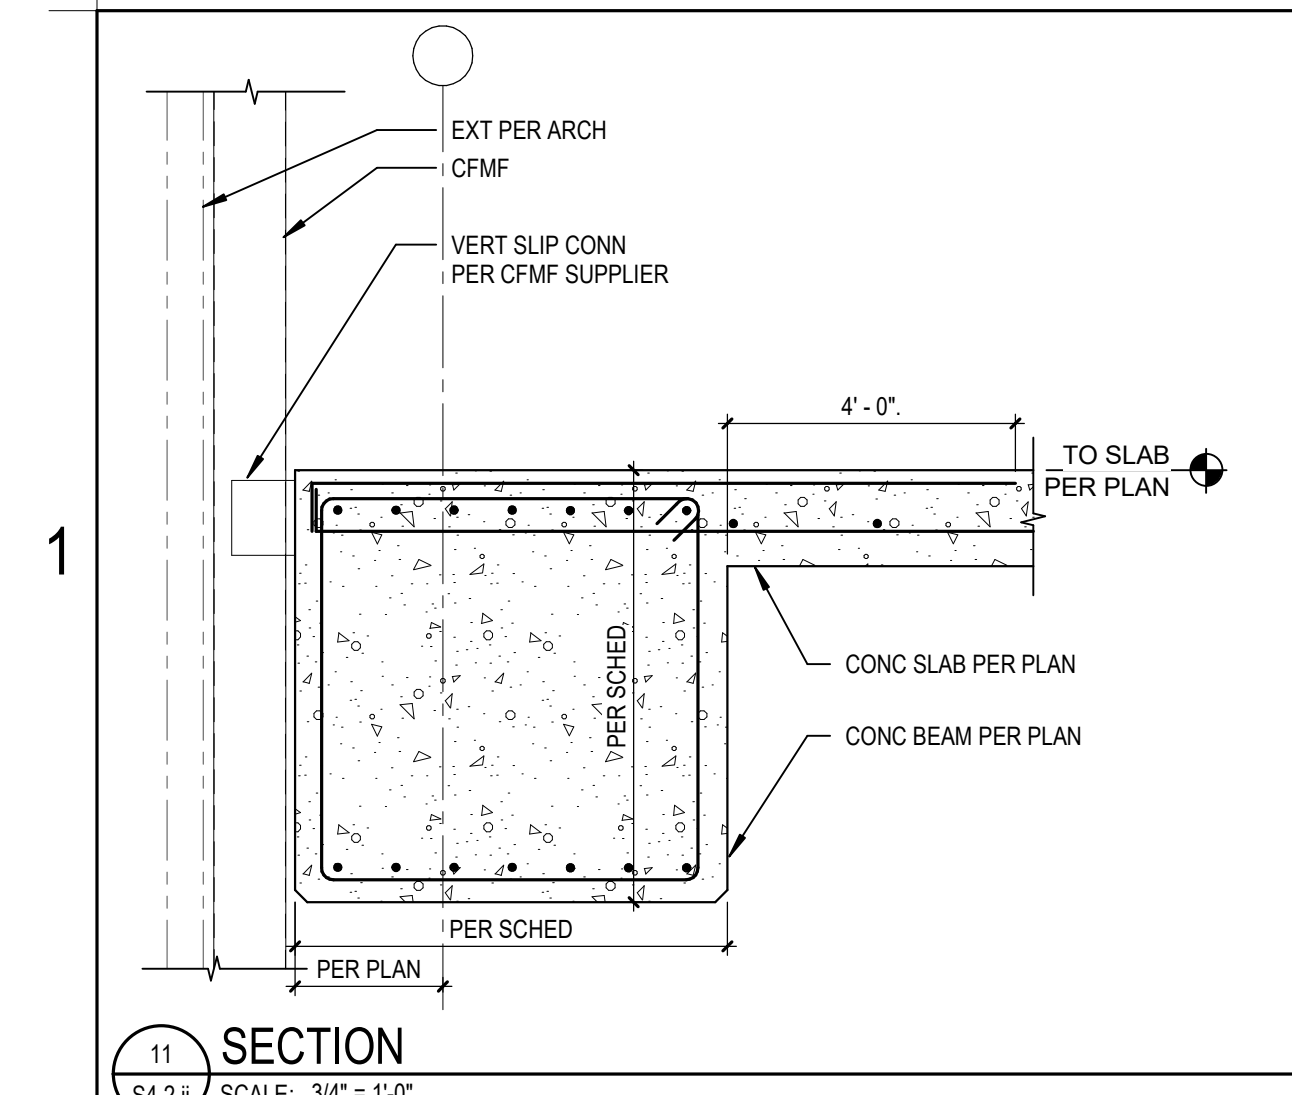


11 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

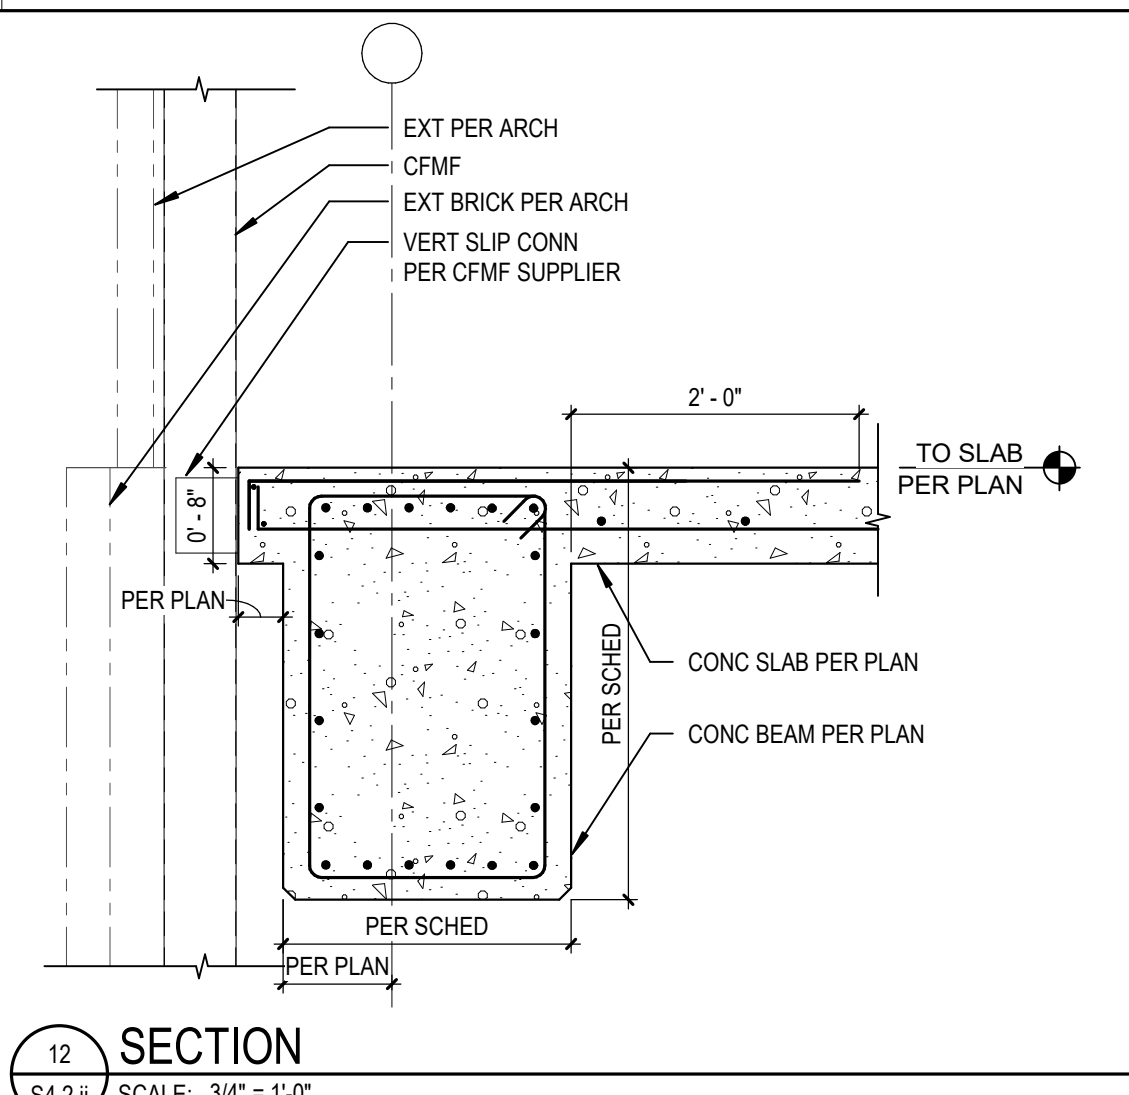


12 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

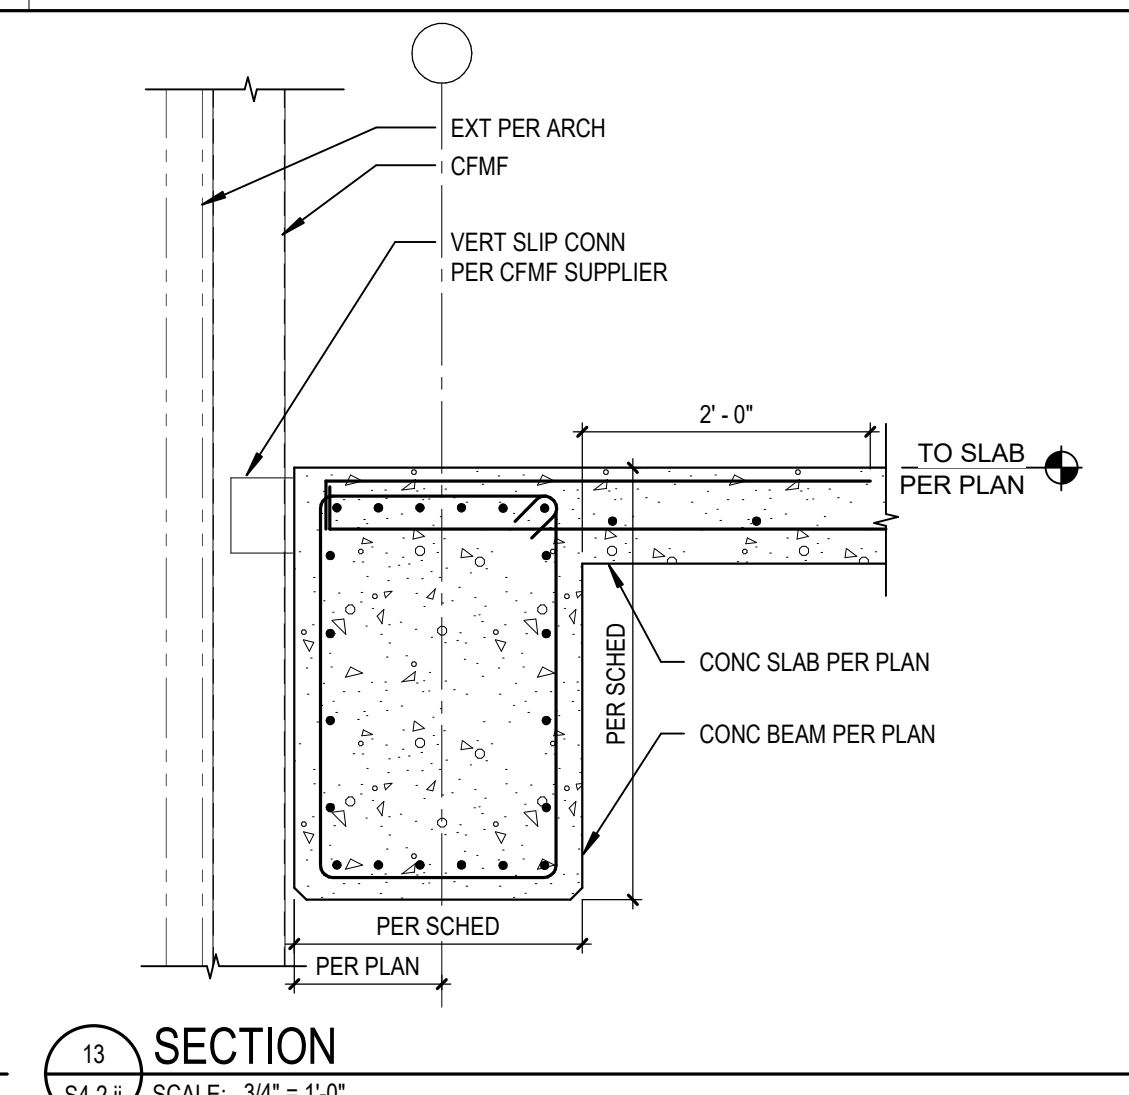


13 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

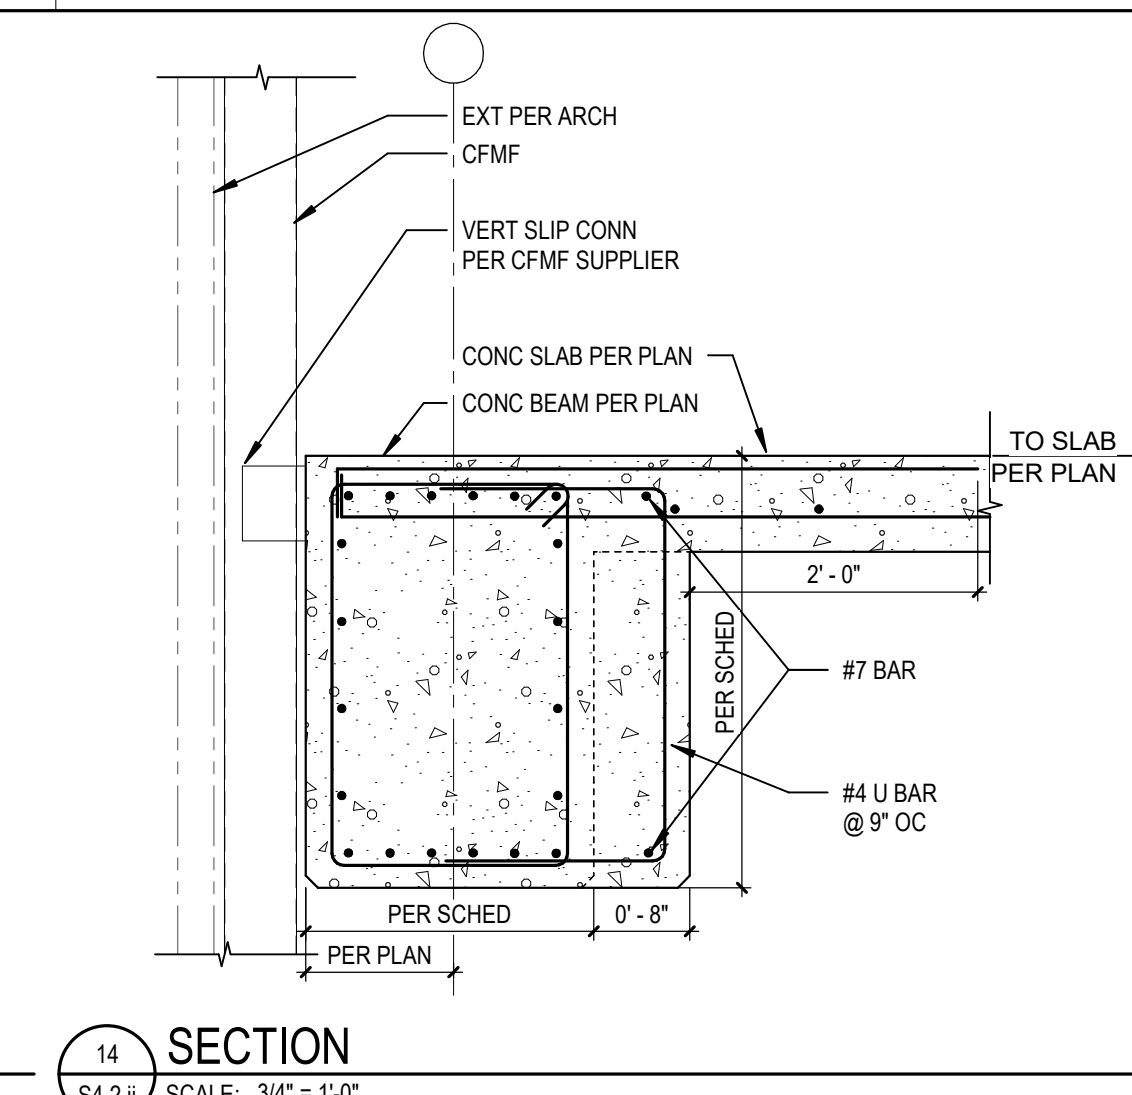



14 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

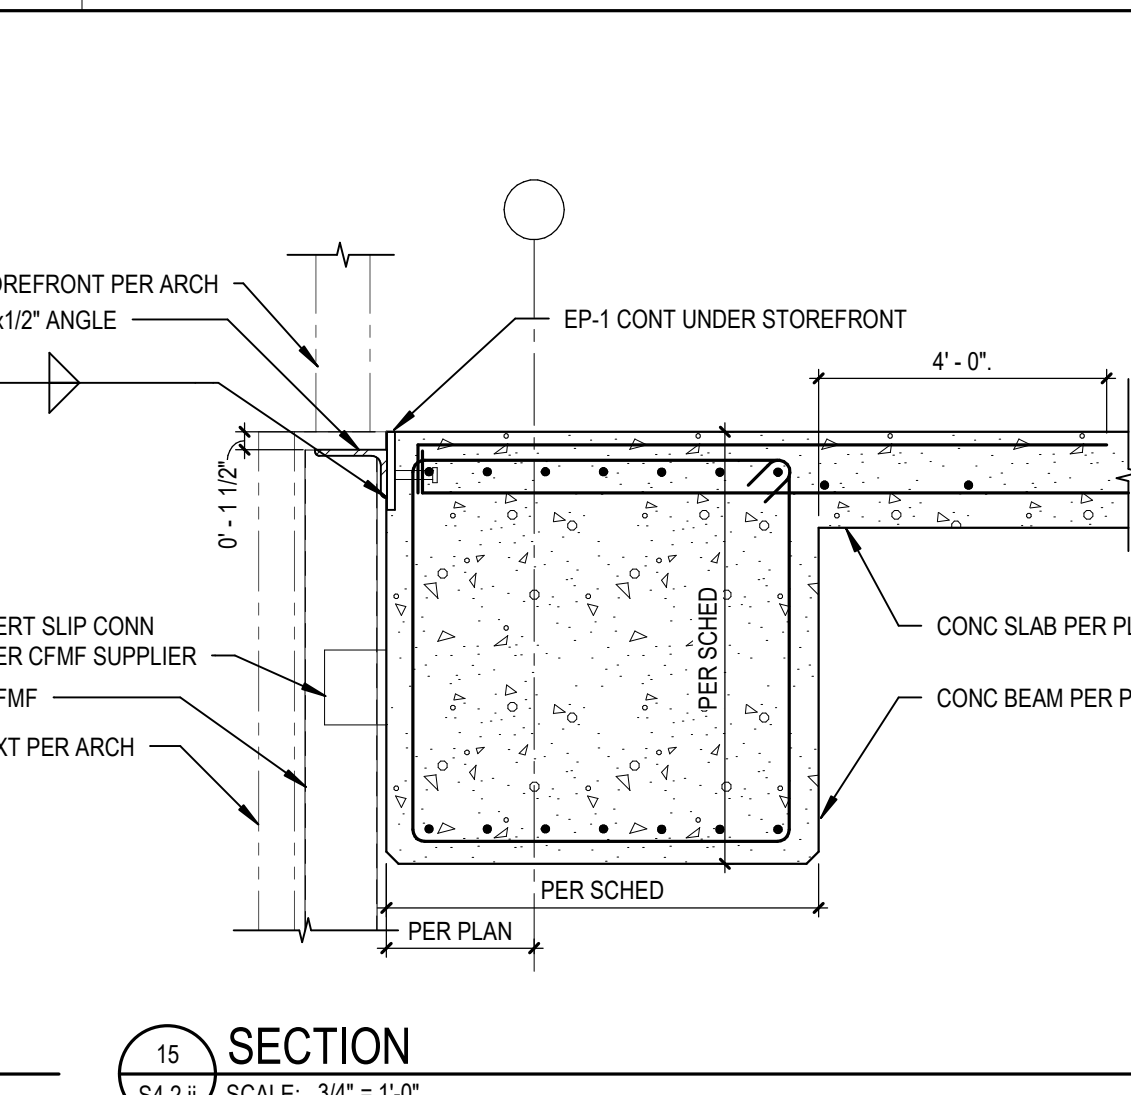


15 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

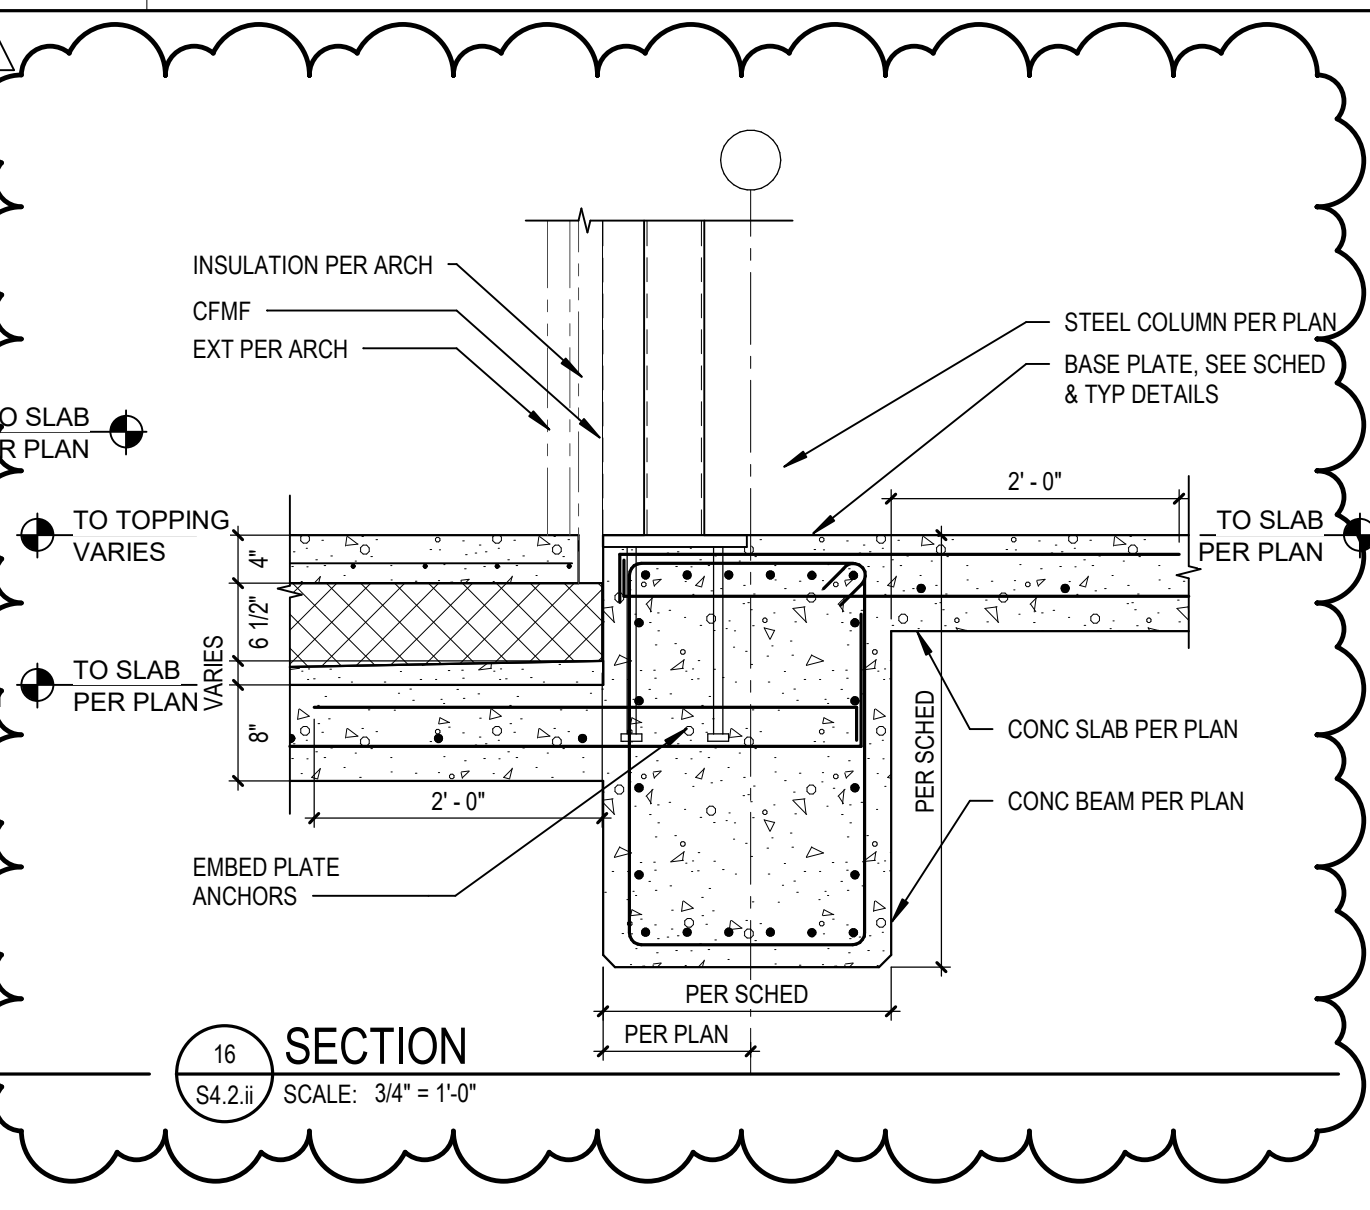


16 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

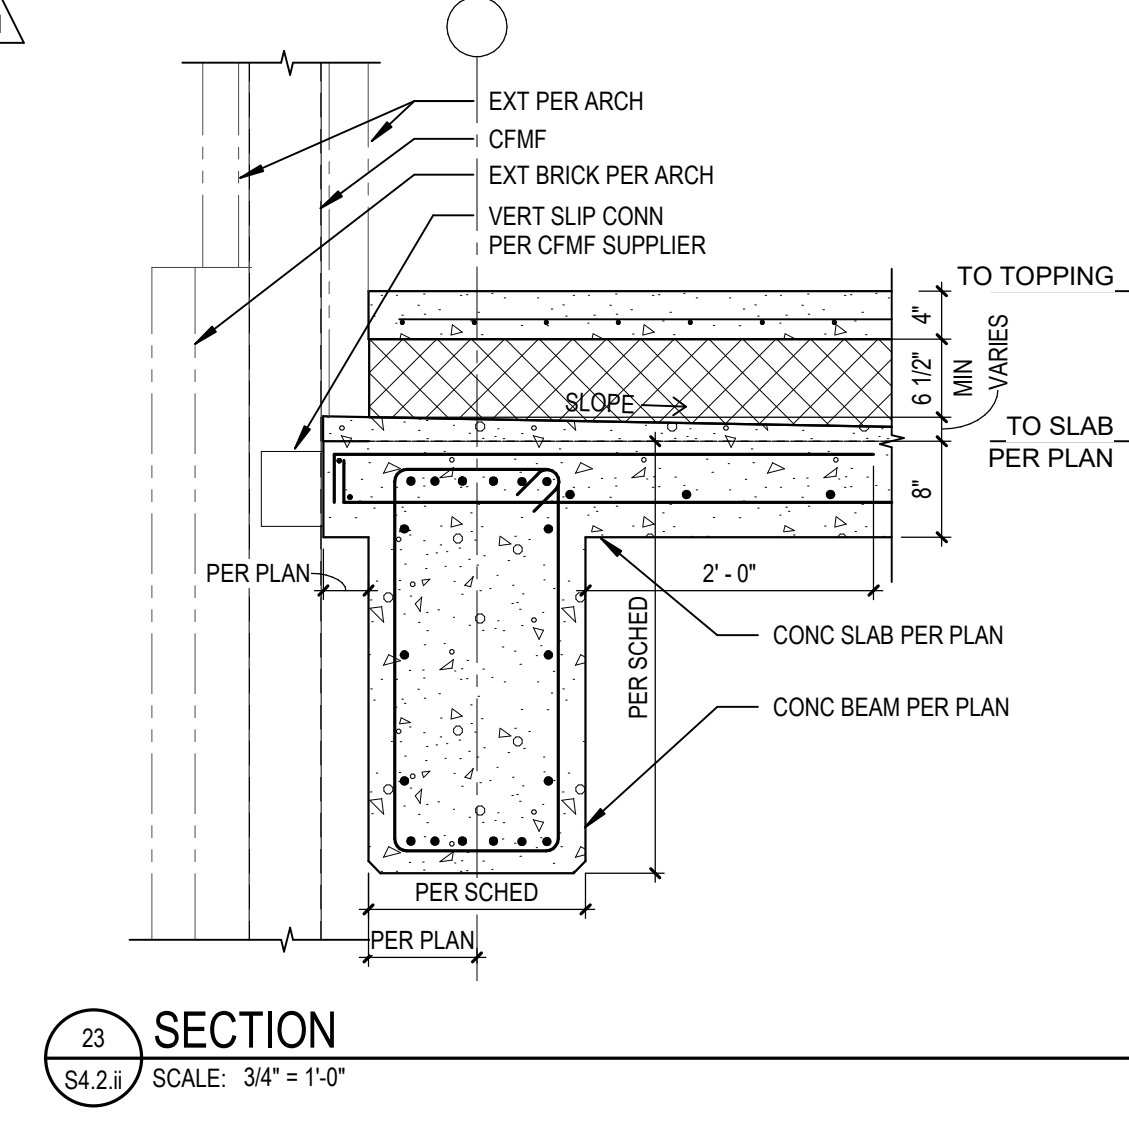


18 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

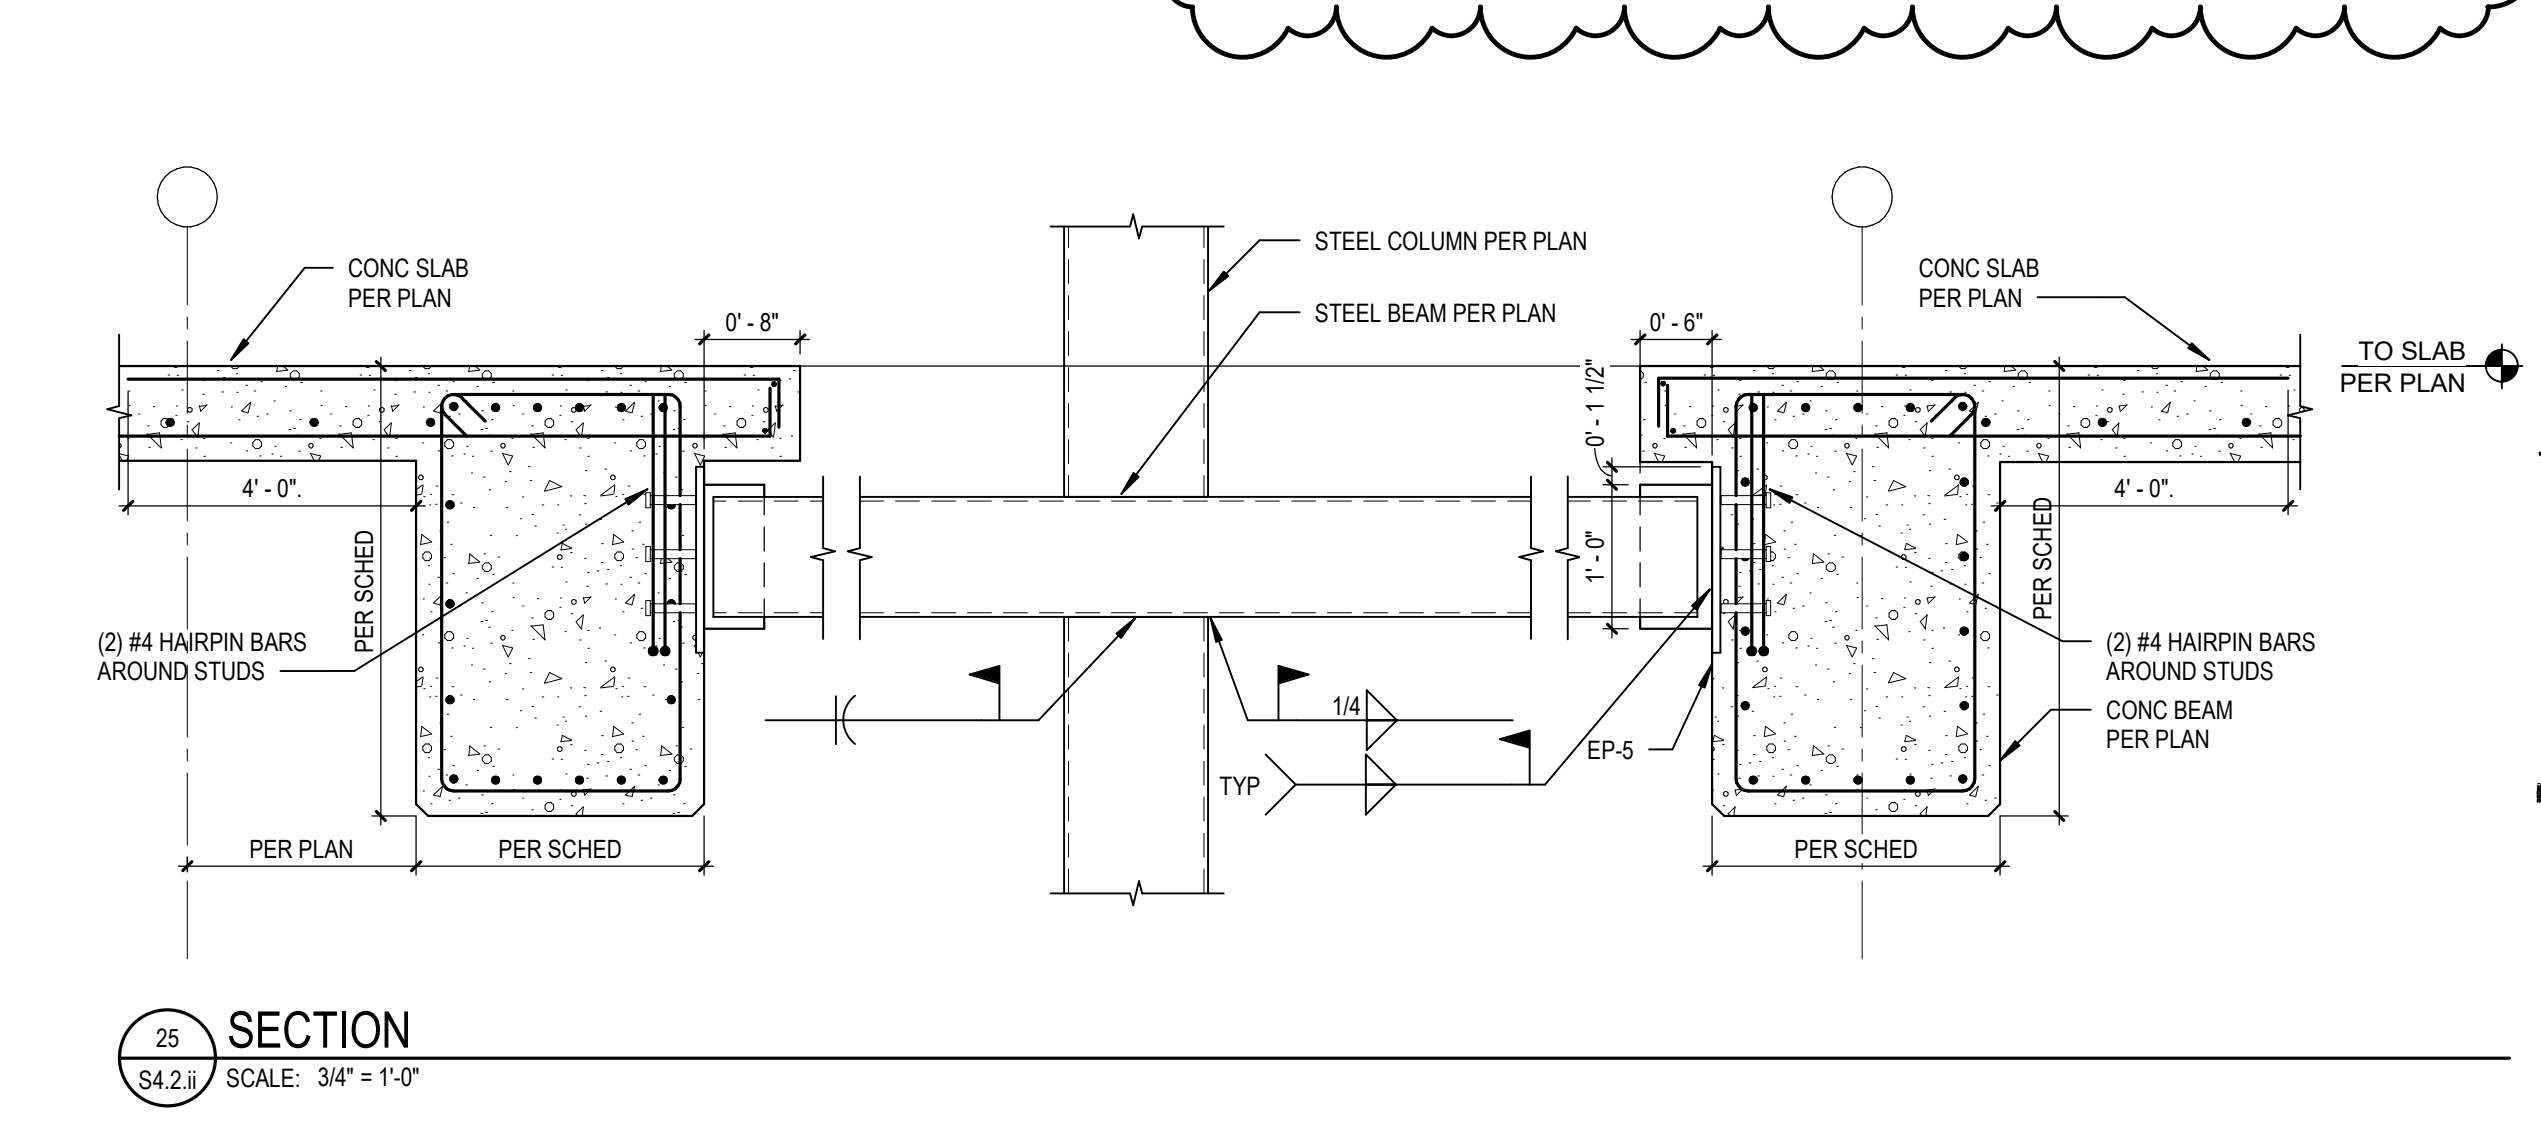


19 SECTION
S4.2.i SCALE: 3/4" = 1'-0"

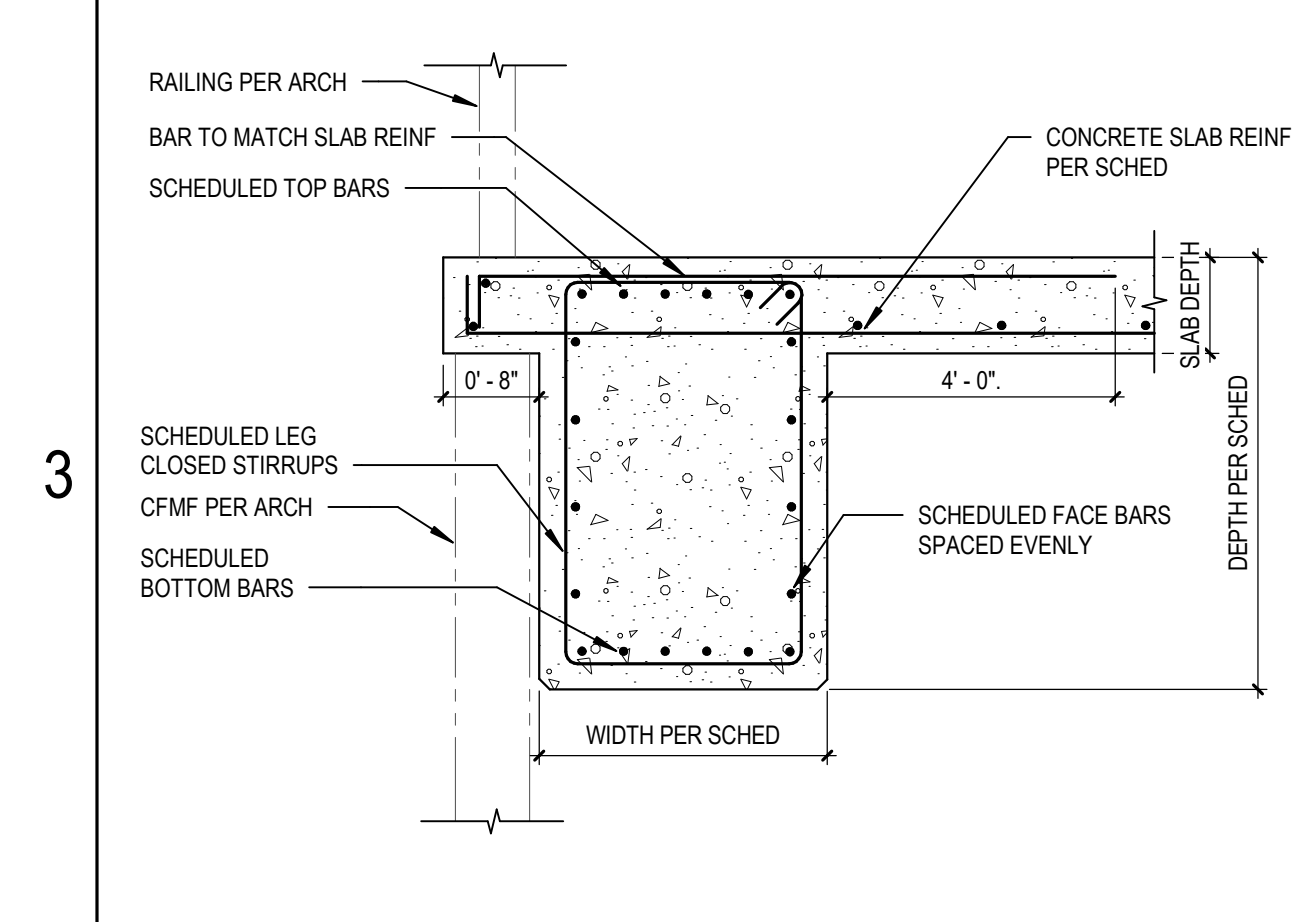

31 TYP CONCRETE BEAM DETAIL
S4.2.i SCALE: 3/4" = 1'-0"

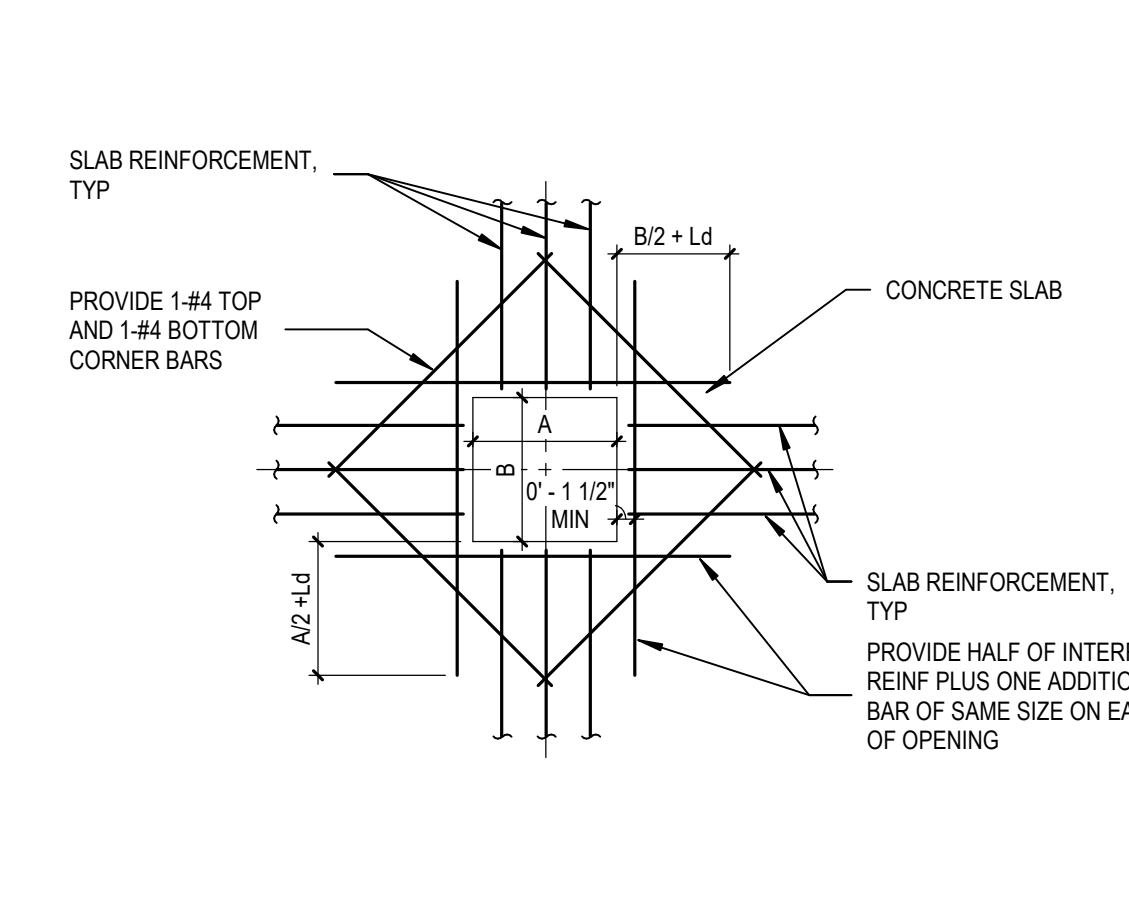


33 TYP CONCRETE FLOOR AND WALL OPENING
S4.2.i SCALE: 3/4" = 1'-0"

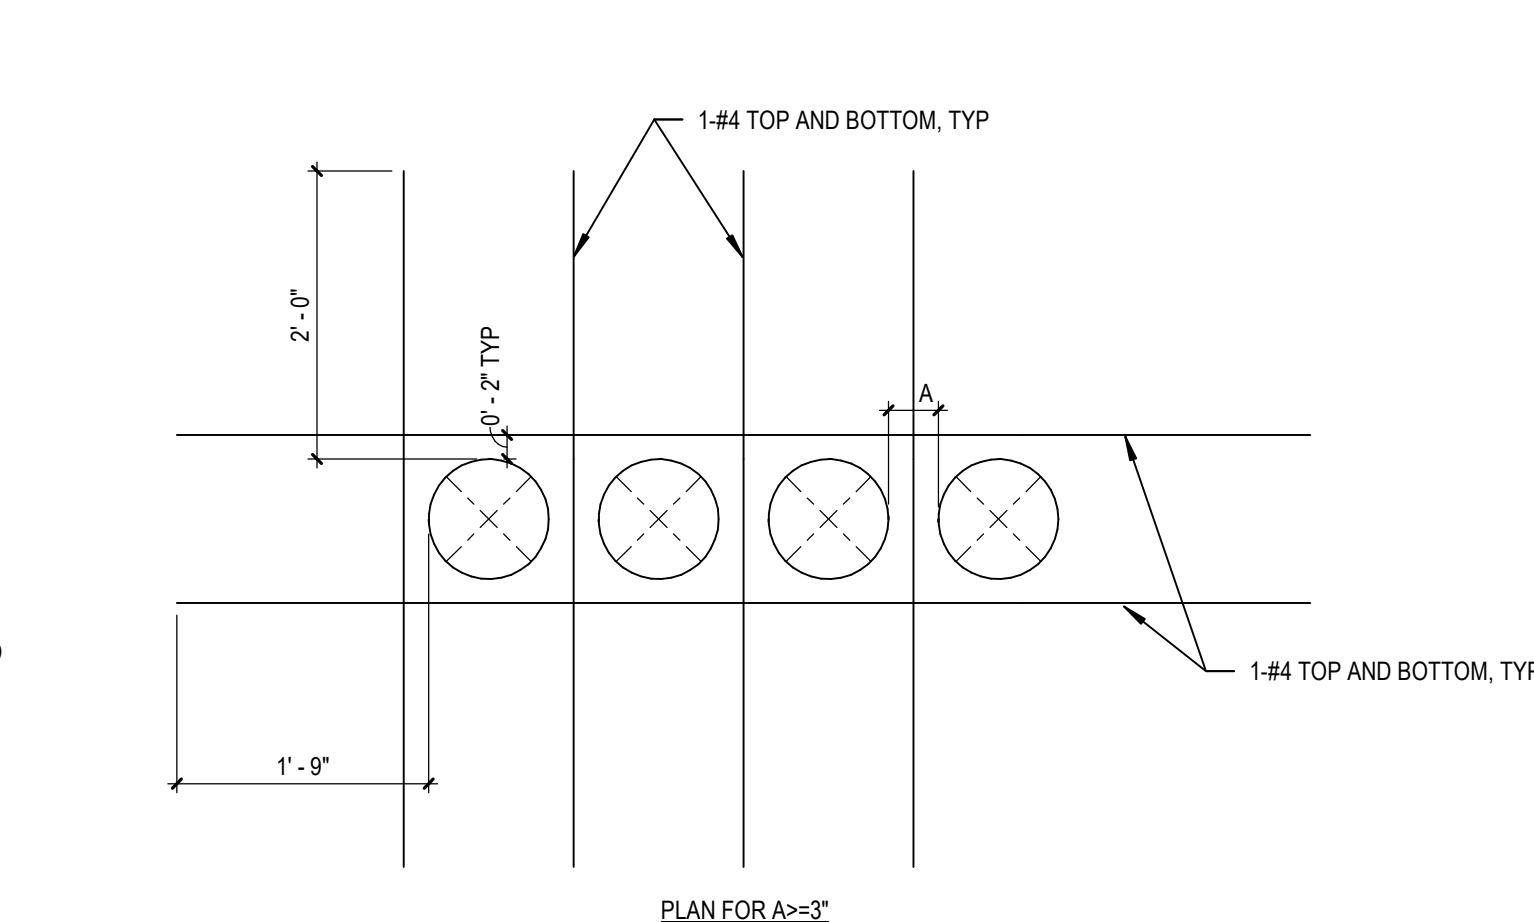

PLAN FOR A>=3"


- NOTES:
- WHERE CLEAR SPACING BETWEEN ADJACENT SLEEVES IS LESS THAN 3" THE SLEEVE GROUP SHALL BE TREATED AS AN EQUIVALENT RECTANGULAR OPENING WITH LENGTH "L" AND WIDTH "W" AS SHOWN.
 - REINFORCEMENT SHOWN IS IN ADDITION TO SCHEDULED SLAB REINFORCEMENT.
 - SCHEDULED SLAB MESH REINFORCEMENT MAY BE CUT AS REQUIRED TO MISS PIPE SLEEVES.
 - REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR LOCATION AND SIZE OF SLEEVES.
 - ISOLATED PIPE SLEEVES THAT ARE SMALLER THAN 5" AND DO NOT INTERRUPT REINFORCEMENT DO NOT REQUIRE THE USE OF THIS DETAIL.
 - THIS DETAIL SHOULD NOT BE USED FOR OPENING GROUPS WITH DIAMETERS LARGER THAN 12" CONSULT STRUCTURAL ENGINEER FOR FRAMING OF SUCH CONDITIONS.
 - PROVIDE HALF OF INTERRUPTED REINFORCEMENT PLUS ONE ADDITIONAL BAR OF SAME SIZE ON EACH SIDE OF EQUIVALENT RECTANGULAR OPENING. PROVIDE A MINIMUM OF 1#4 TOP AND BOTTOM EACH SIDE OF OPENING.

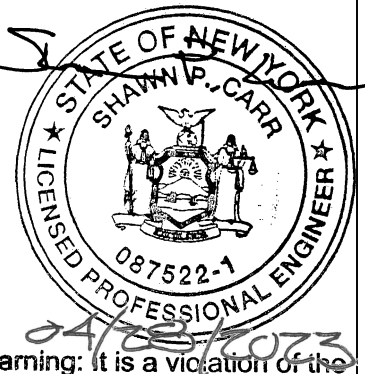


Warning: It is a violation of the law for any person, unless acting under the direction of a licensed Design Professional, to alter an item in any way.

BID SET


11.04.22	
REVISIONS	
1 CONSTRUCTION DOCS	03.06.23
2 ASI 02	04.27.23

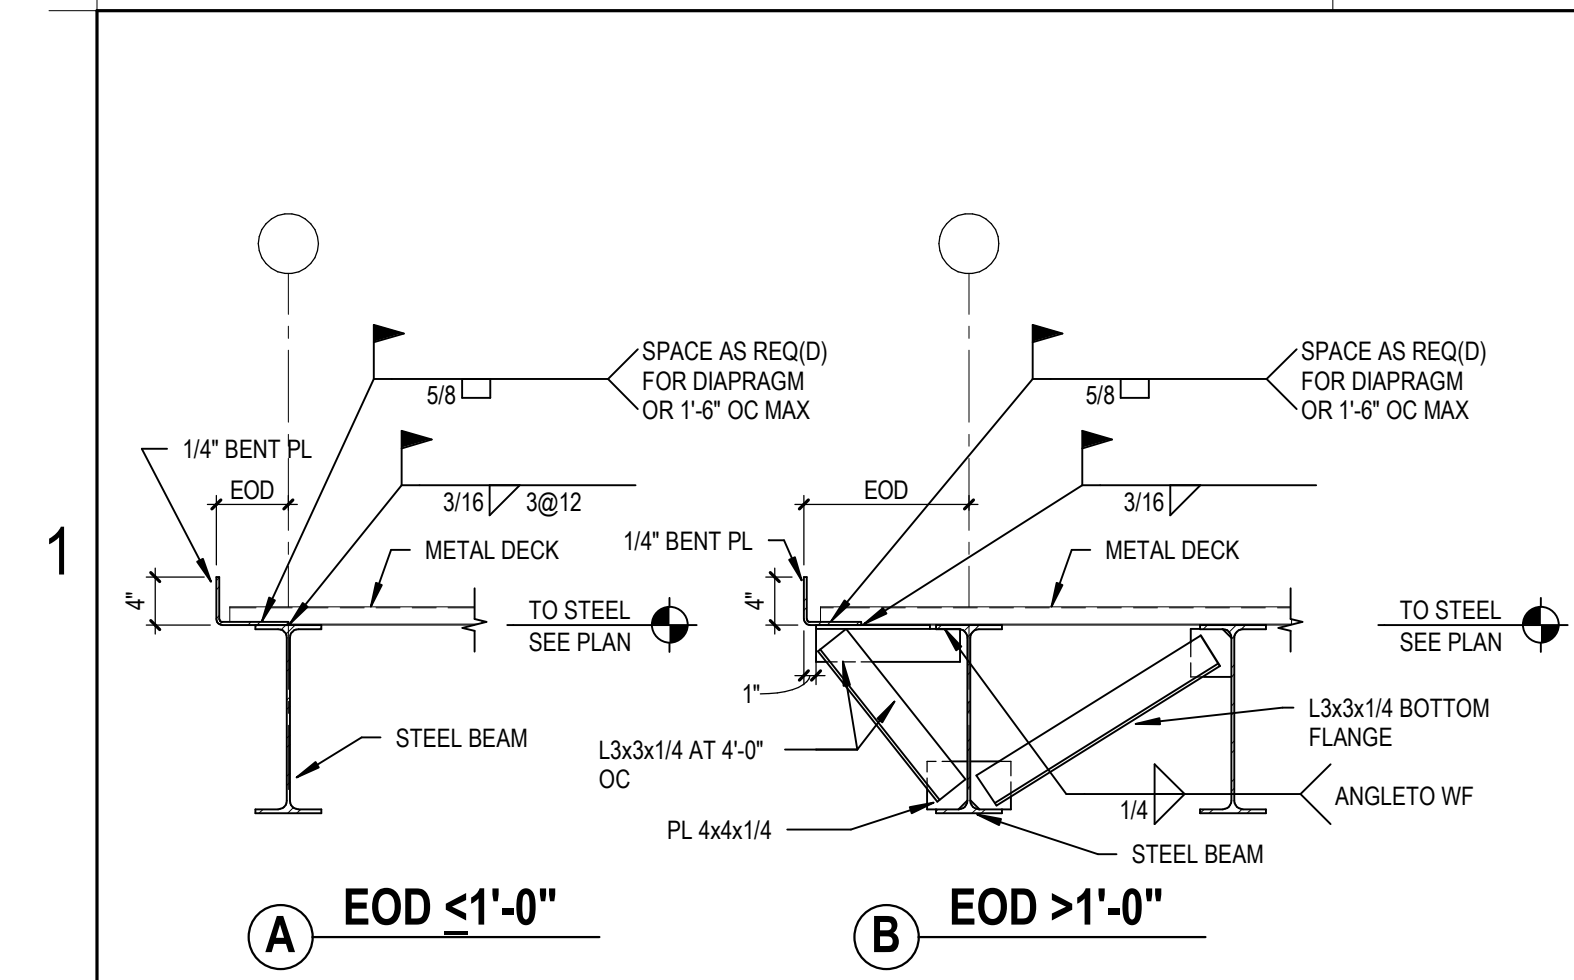


11 TYP EDGE OF DECK DETAIL
SCALE: 3/4" = 1'-0"

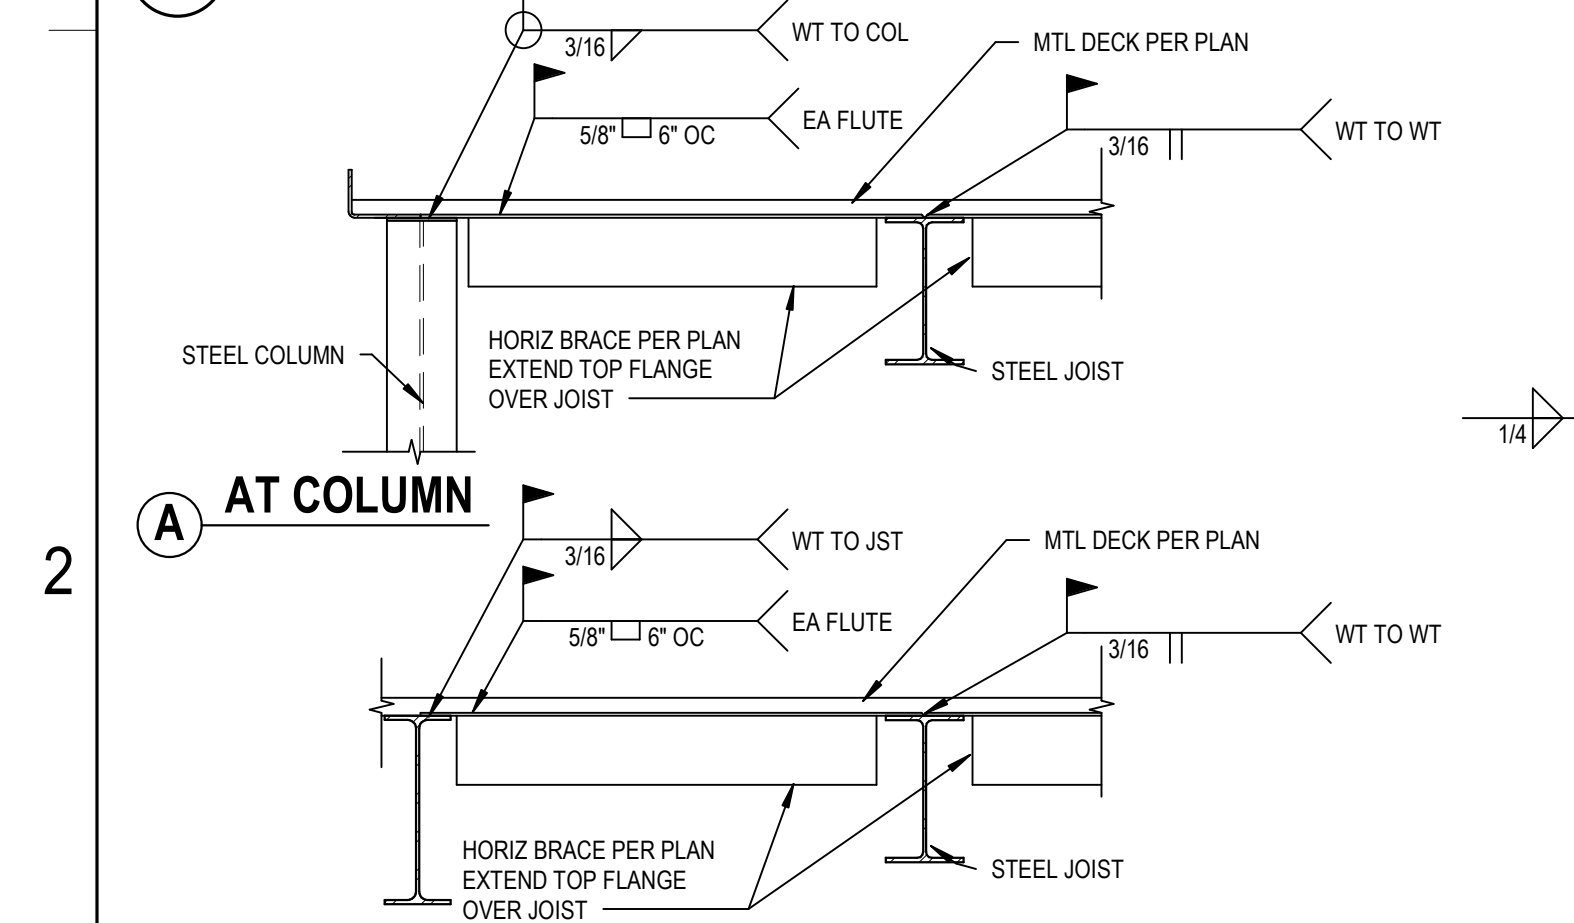


21 TYP WT BRACE DETAIL
SCALE: 3/4" = 1'-0"

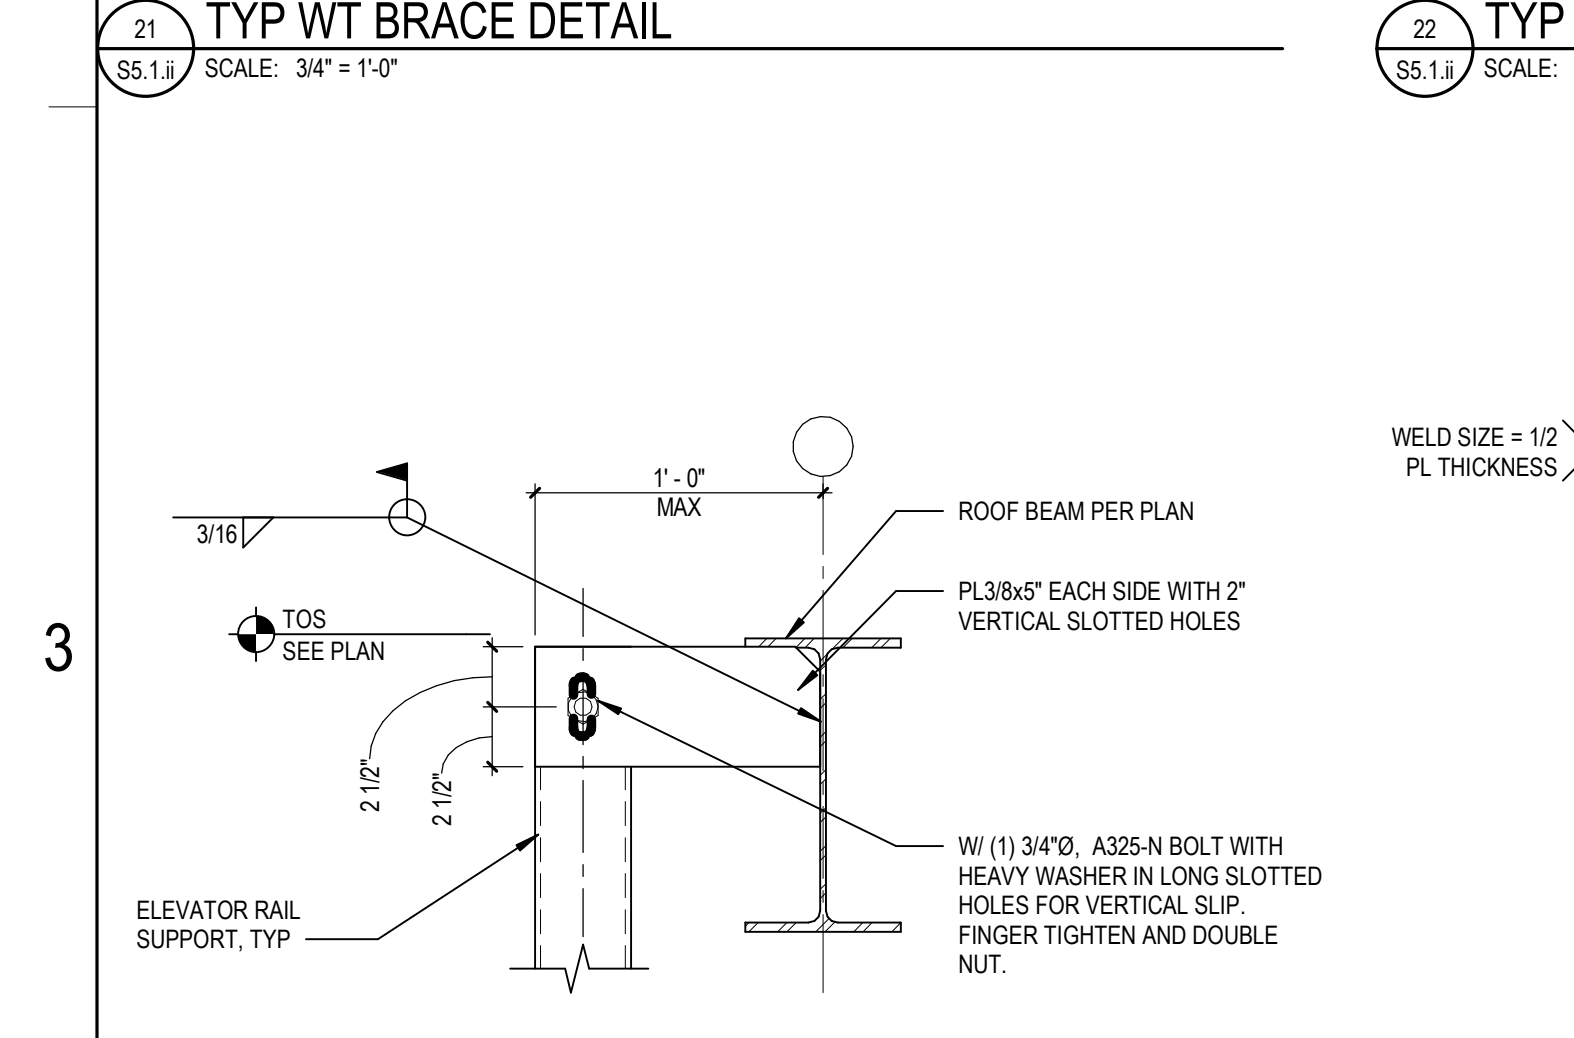


22 TYP ROOF OPENING DETAIL
SCALE: 3/4" = 1'-0"

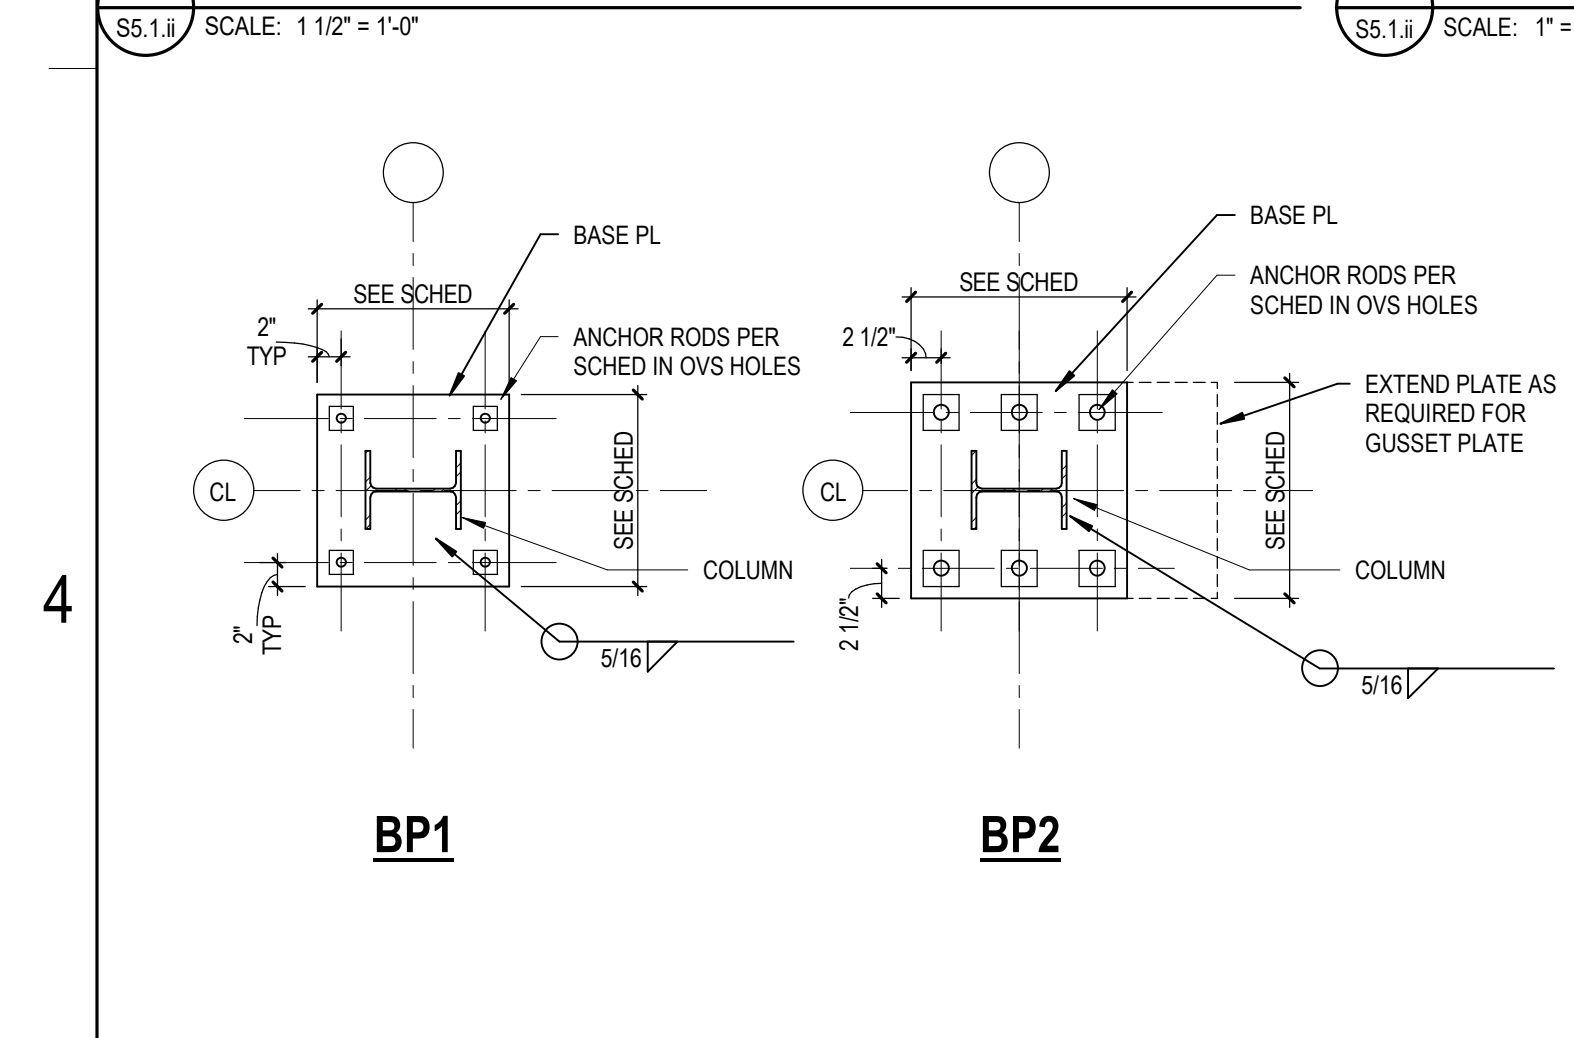


23 TYP BEAM OVER COLUMN DETAIL
SCALE: 1" = 1'-0"

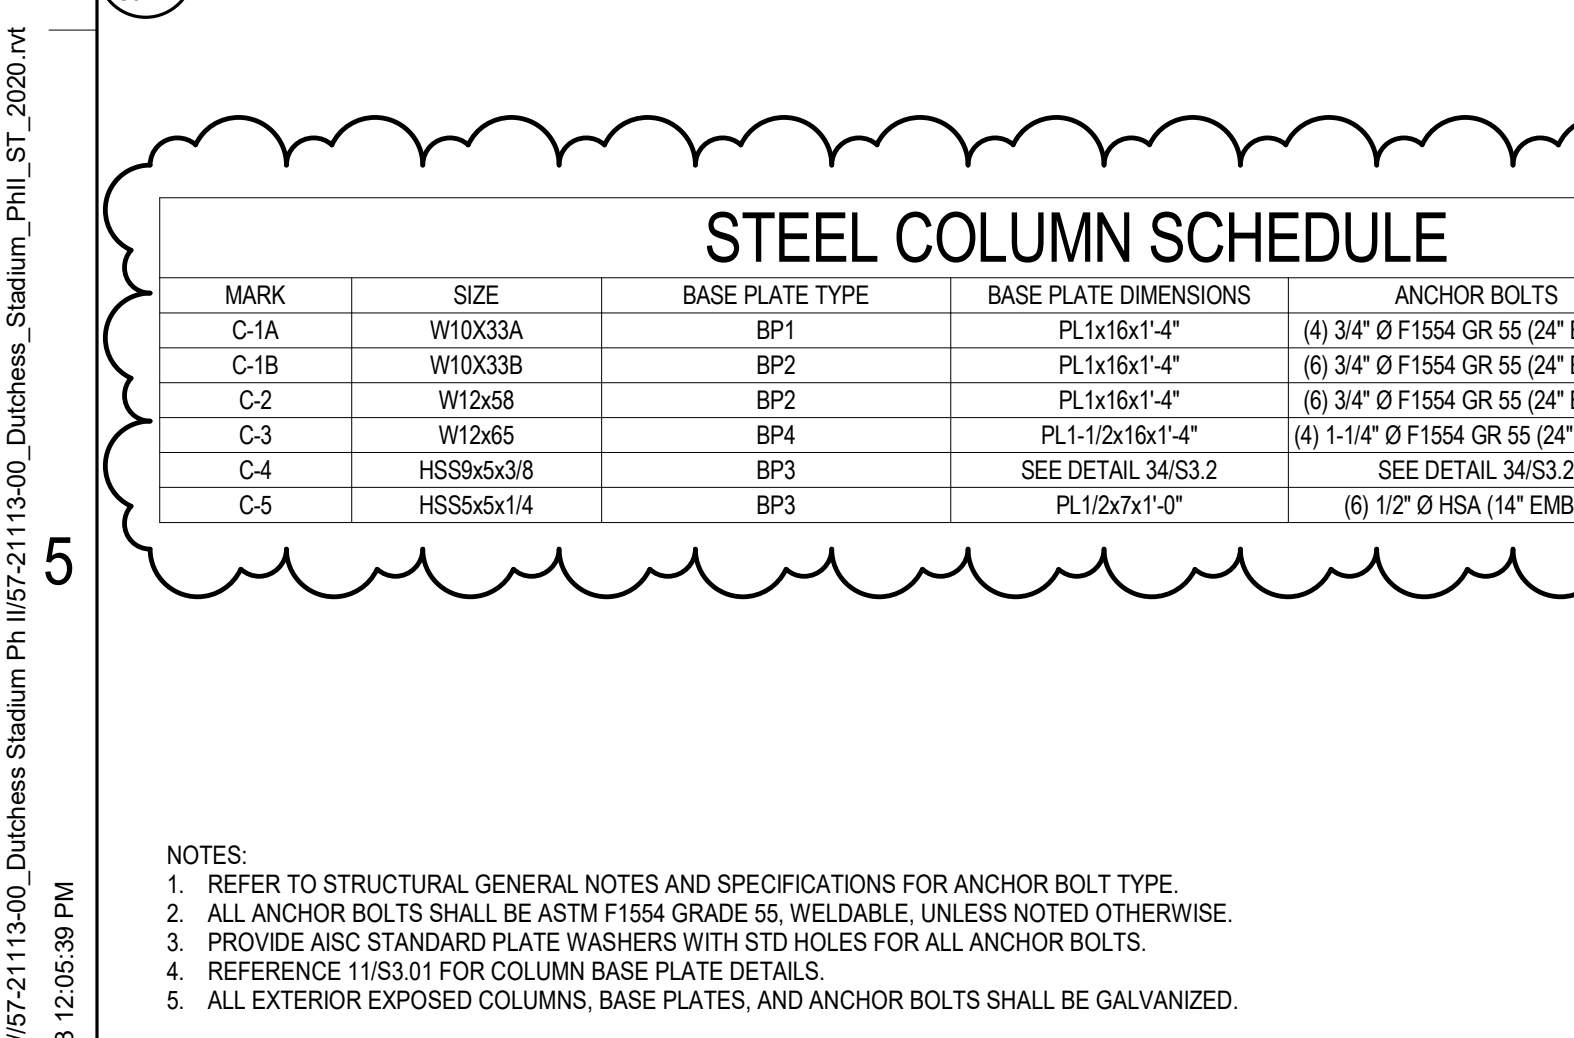


24 TYP STEEL BEAM CONNECTION DETAIL
SCALE: 1" = 1'-0"

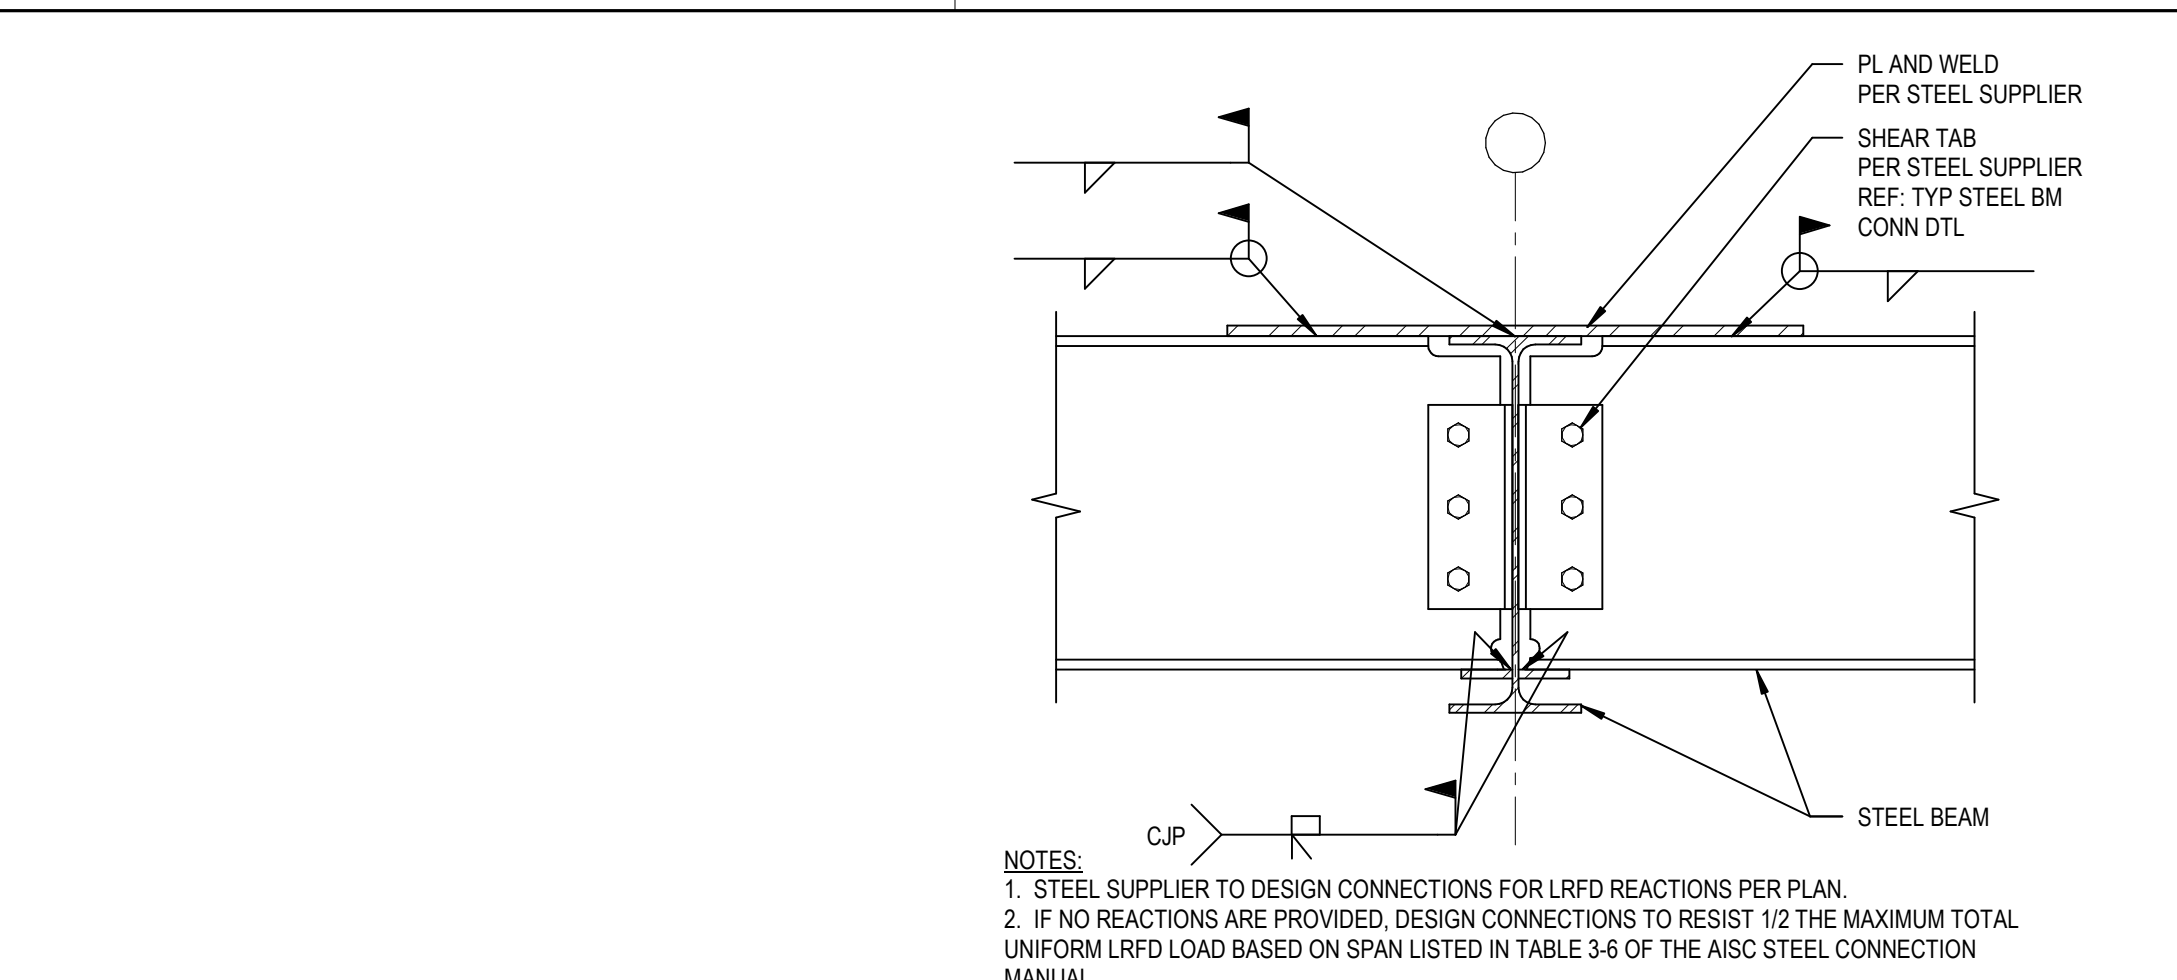


25 TYP STEEL BEAM CONNECTION DETAIL
SCALE: 1" = 1'-0"

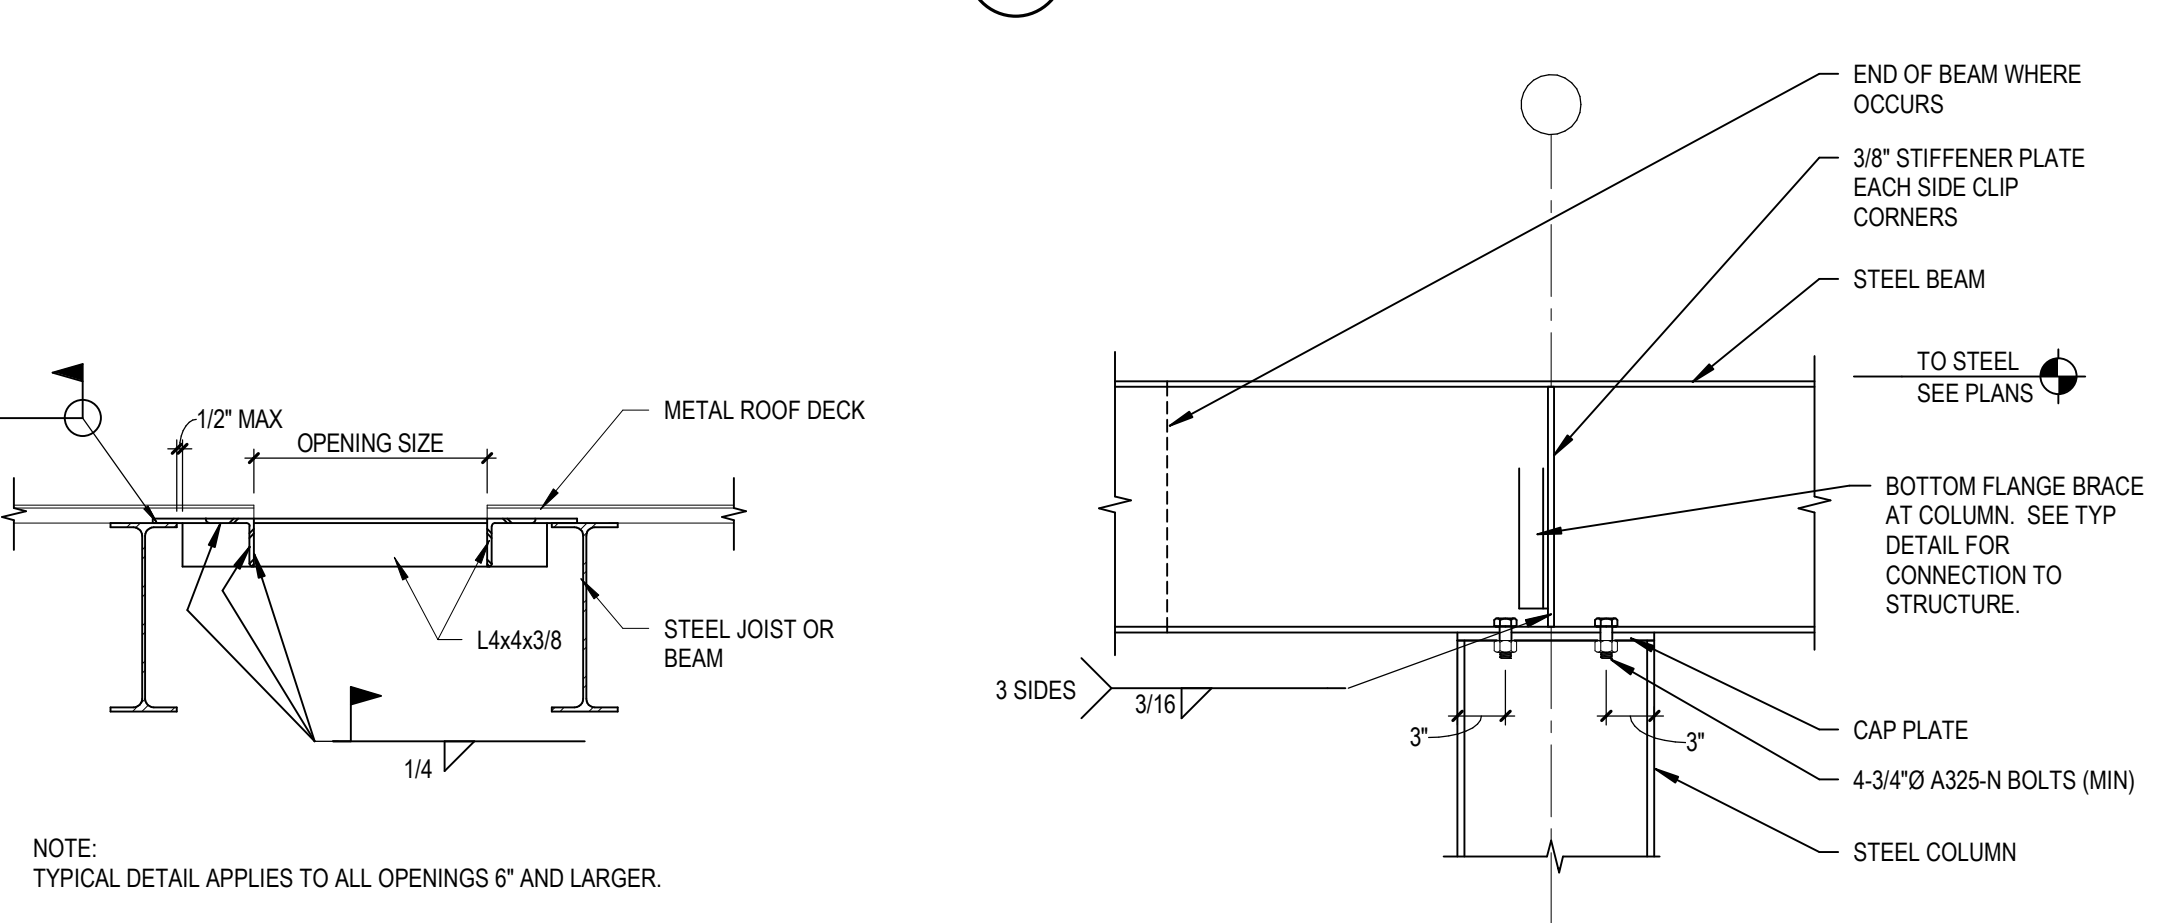


26 TYP CONT BENT PL SPLICE DET
SCALE: 3/4" = 1'-0"

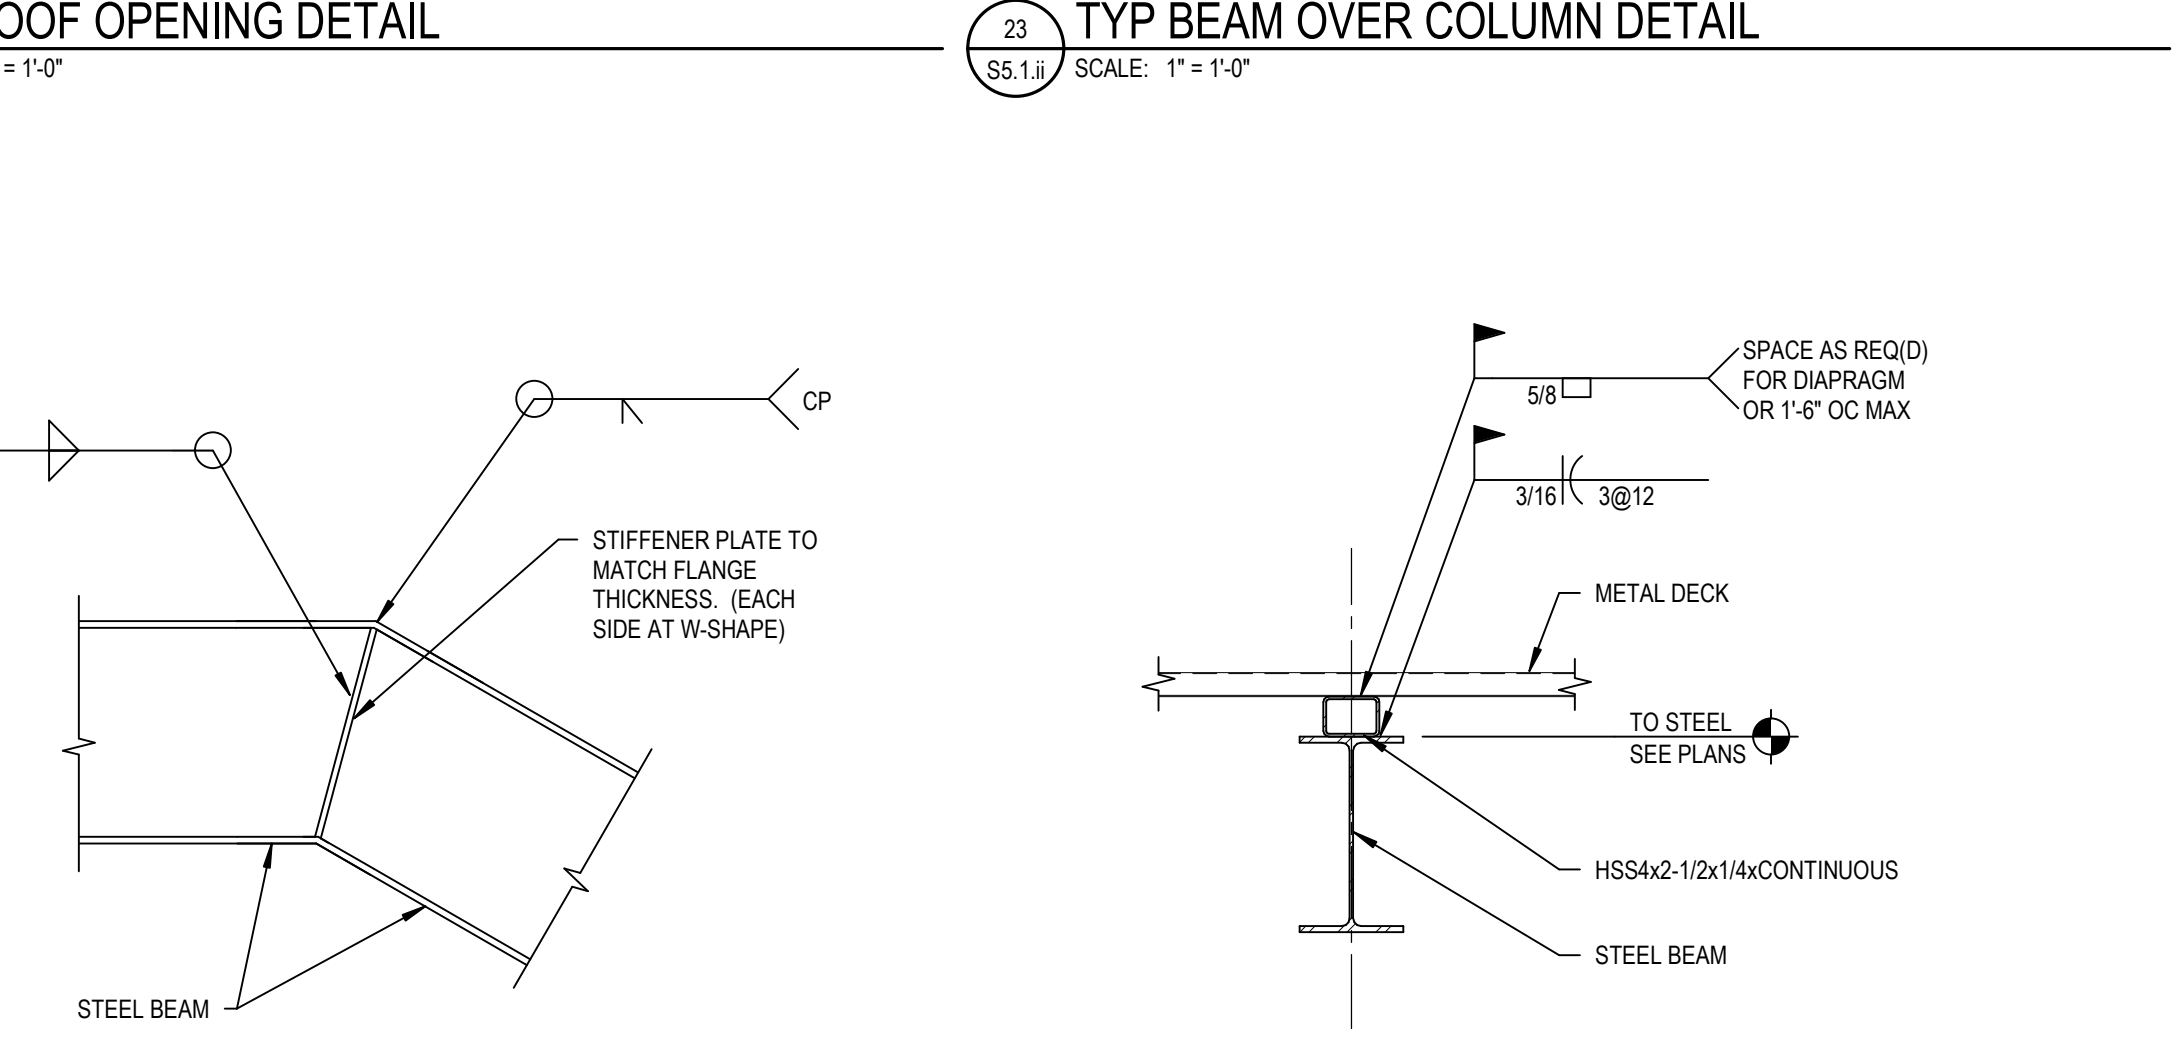

34 TYP HANGING MECH UNIT DETAIL
SCALE: 1" = 1'-0"

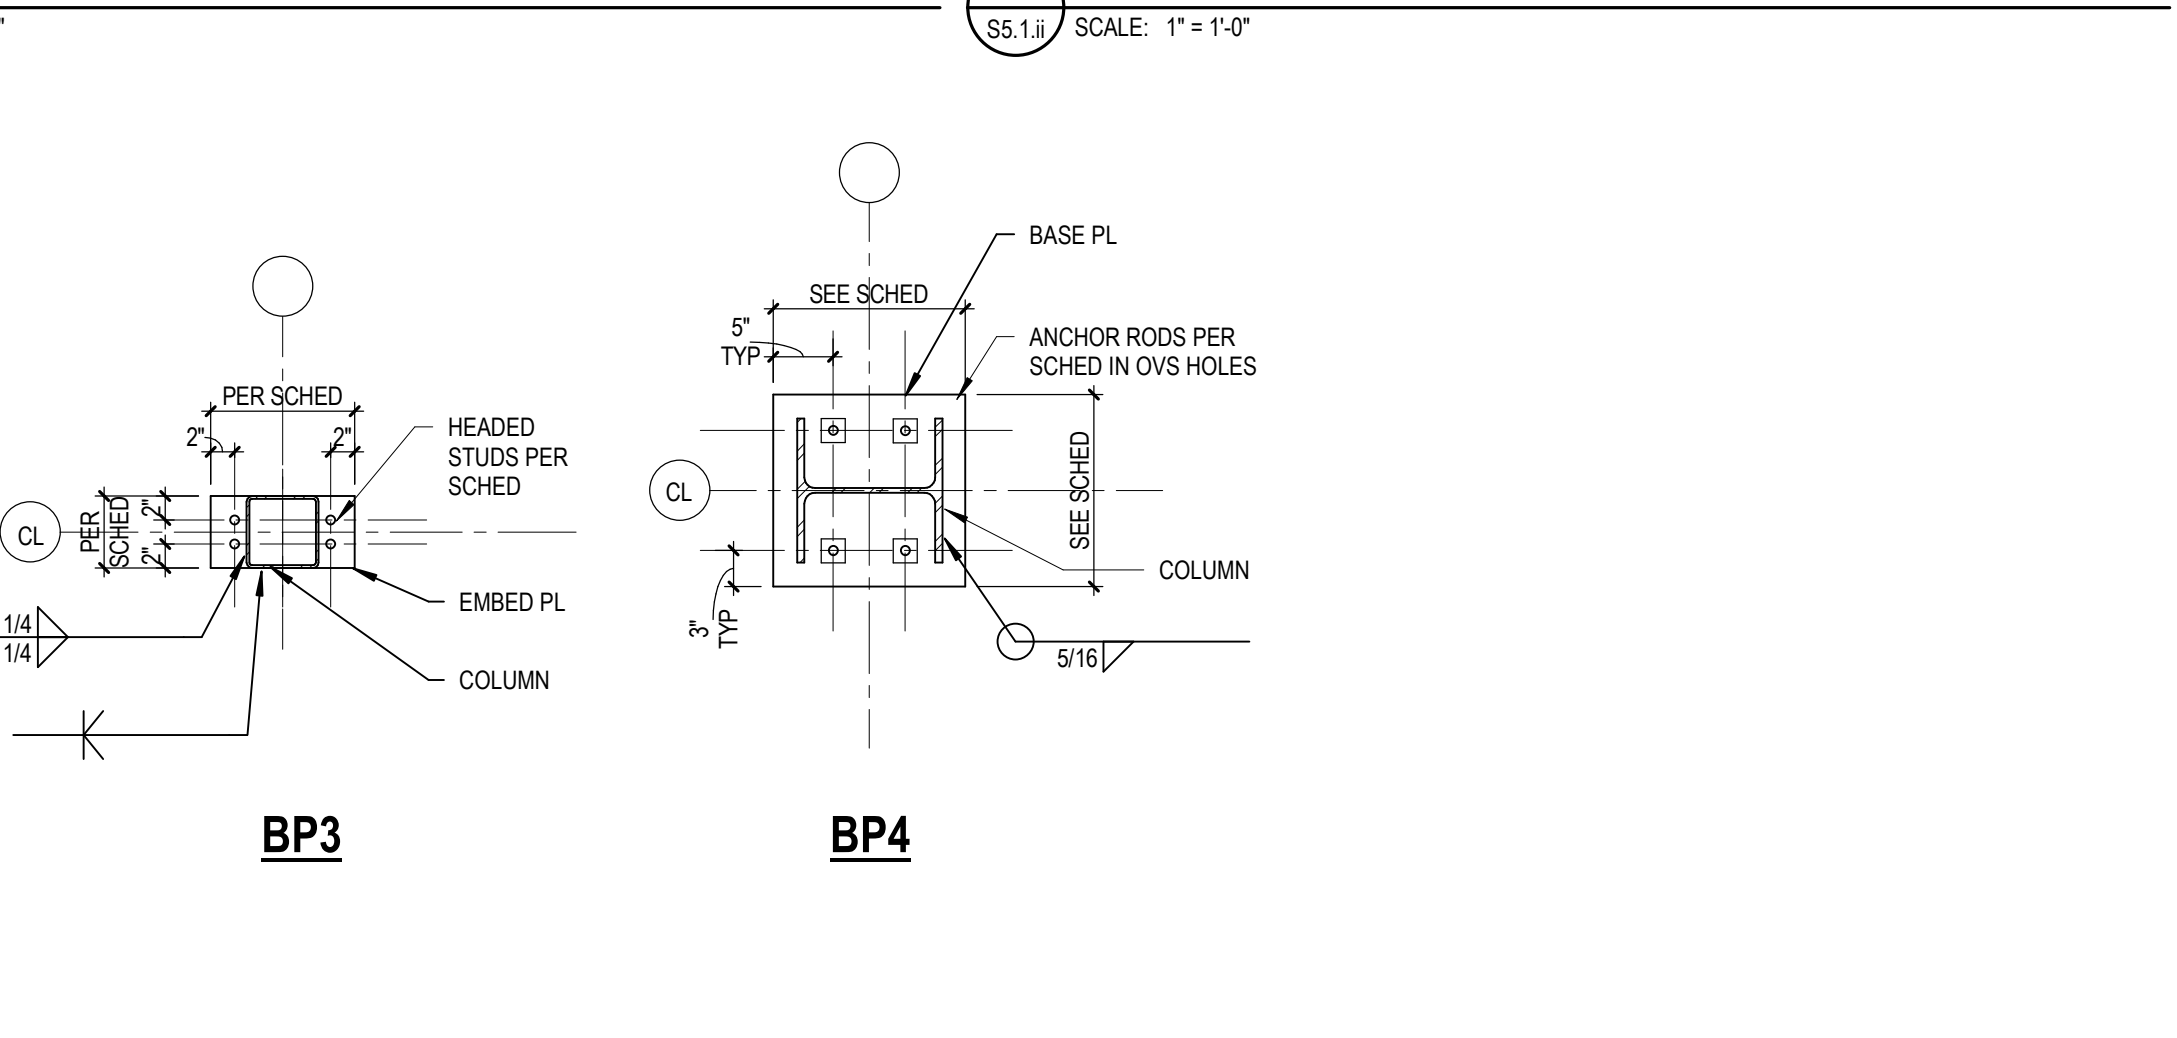

35 TYP HANGING MECH UNIT DETAIL
SCALE: 1" = 1'-0"

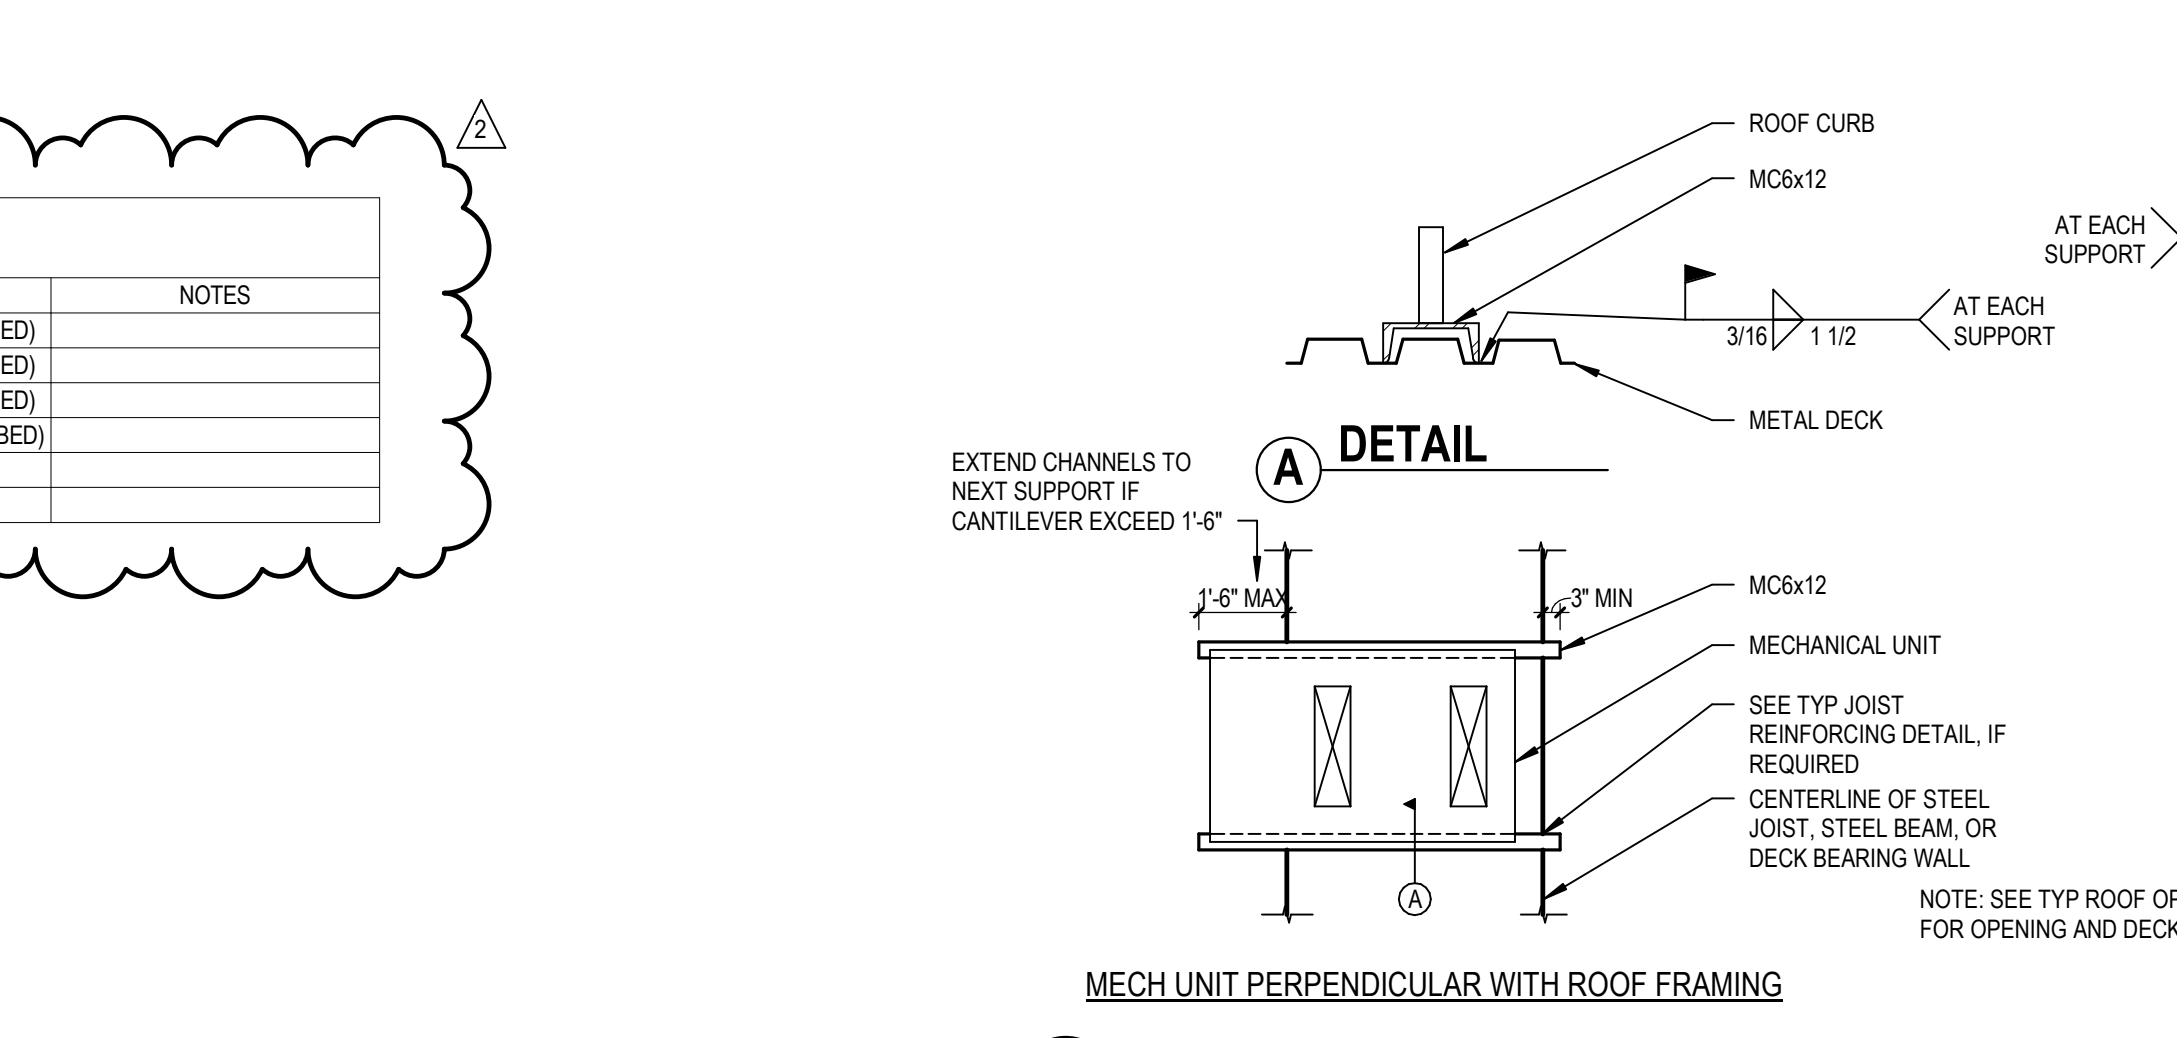

36 TYP BEAM OVER COLUMN DETAIL
SCALE: 1" = 1'-0"

BM SIZE	MIN NO OF BOLTS	L-ANGLE LENGTH
W8, W10	2	5 1/2"
W12, W14	3	8 1/2"
W16, W18	4	11 1/2"
W21	5	14 1/2"
W24	6	17 1/2"
W27	7	20 1/2"
W30, W33	8	23 1/2"
W36	9	26 1/2"


CONNECTION SCHEDULE

BM SIZE	MIN NO OF BOLTS	L-PLATE LENGTH
W8, W10	2	5 1/2"
W12, W14	3	8 1/2"
W16, W18	4	11 1/2"
W21	5	14 1/2"
W24	6	17 1/2"
W27	7	20 1/2"
W30, W33	8	23 1/2"
W36	9	26 1/2"


CONNECTION SCHEDULE

MARK	DESCRIPTION	ALLOWABLE DIAPHRAGM SHEAR
RD-1	1-1/2" DEEP X 20 GA. WIDE RIB PAINTED STEEL ROOF DECK. 1.5820 PROVIDE 5/8" PUDDLE WELDS IN A 30x5 PATTERN AND 5 #10 TEK SCREW SIDE LAPS PER SPAN.	540 PLF


ROOF DECK SCHEDULE

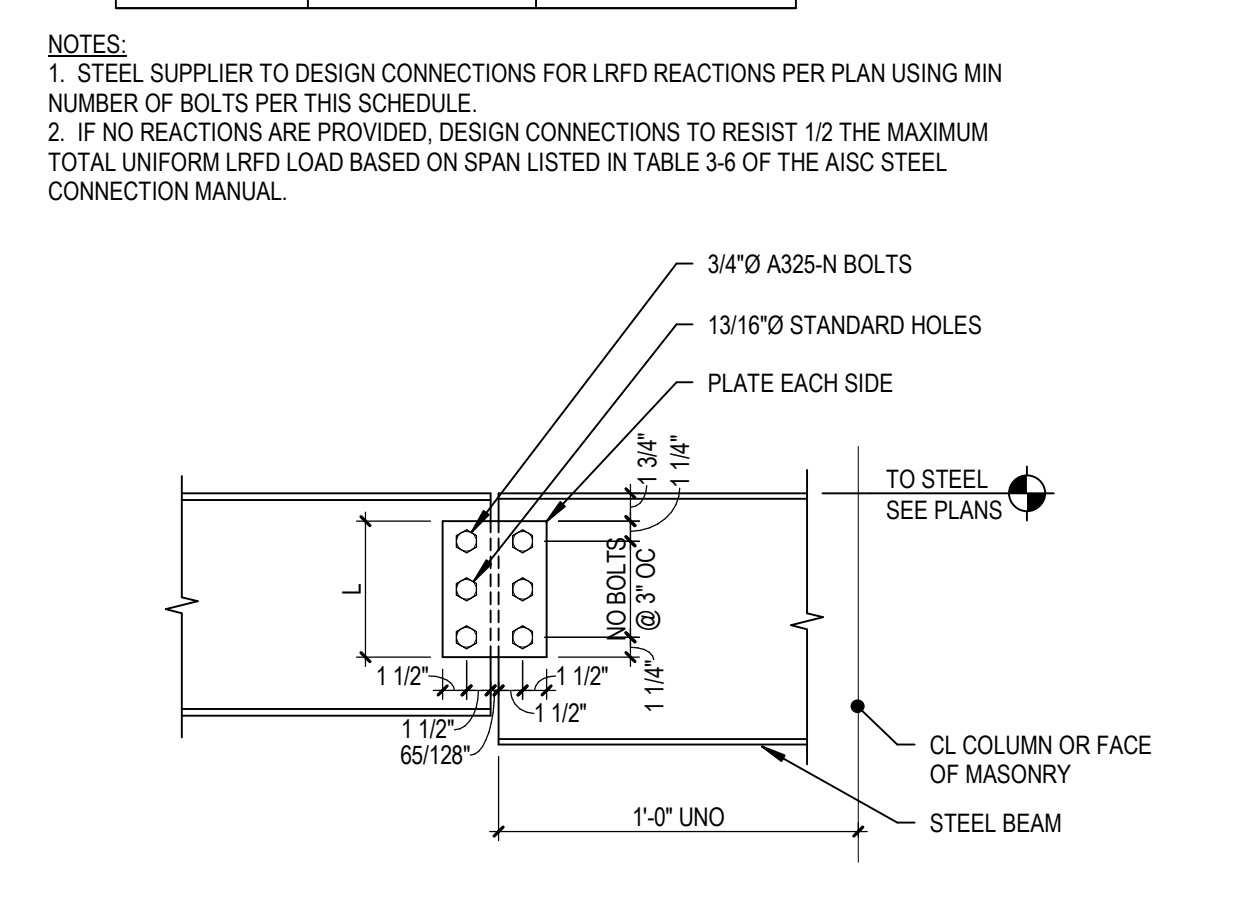


41 COLUMN BASE PLATE DETAILS
SCALE: 3/4" = 1'-0"

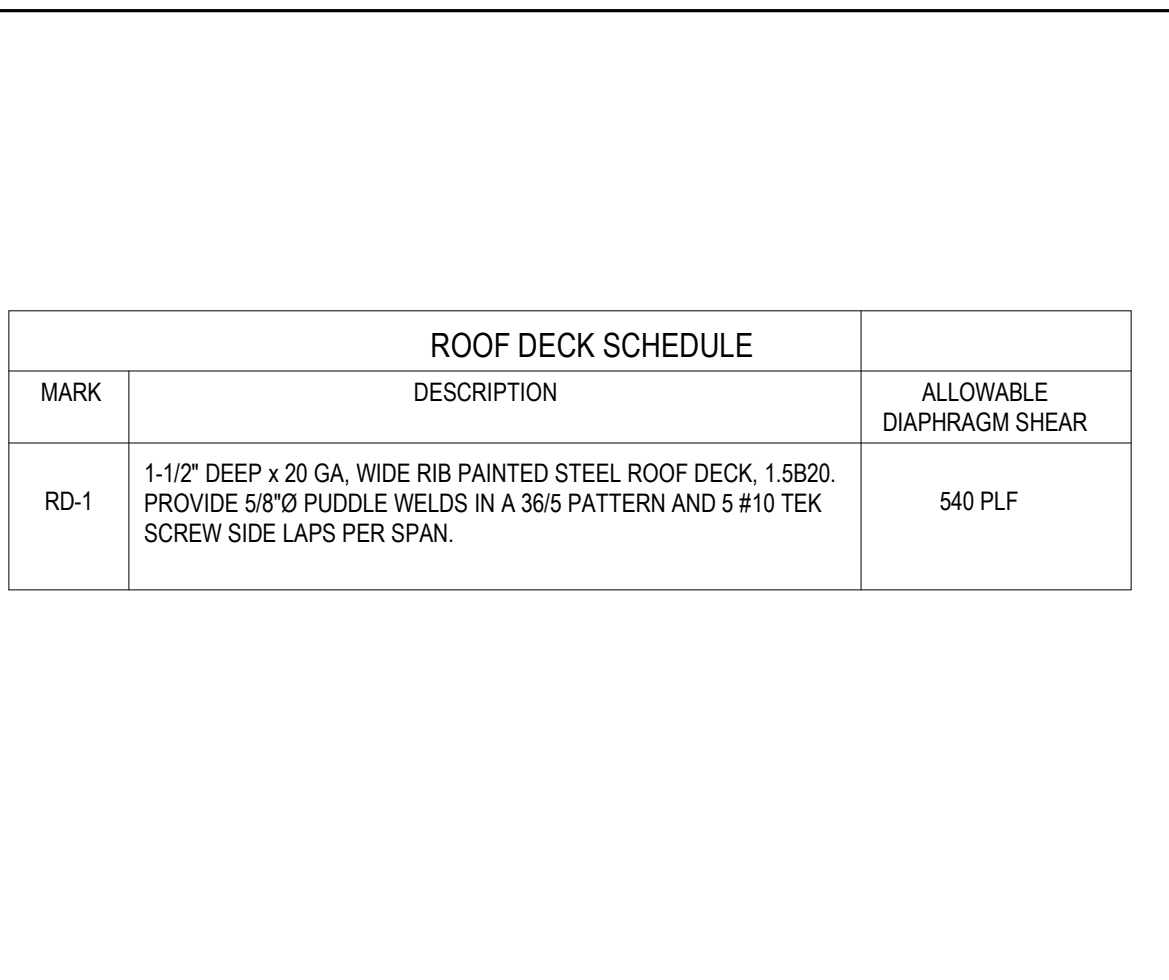

53 TYP ROOF TOP UNIT SUPPORT DETAIL AT 1-1/2" DEEP ROOF DECK
SCALE: 1/2" = 1'-0"

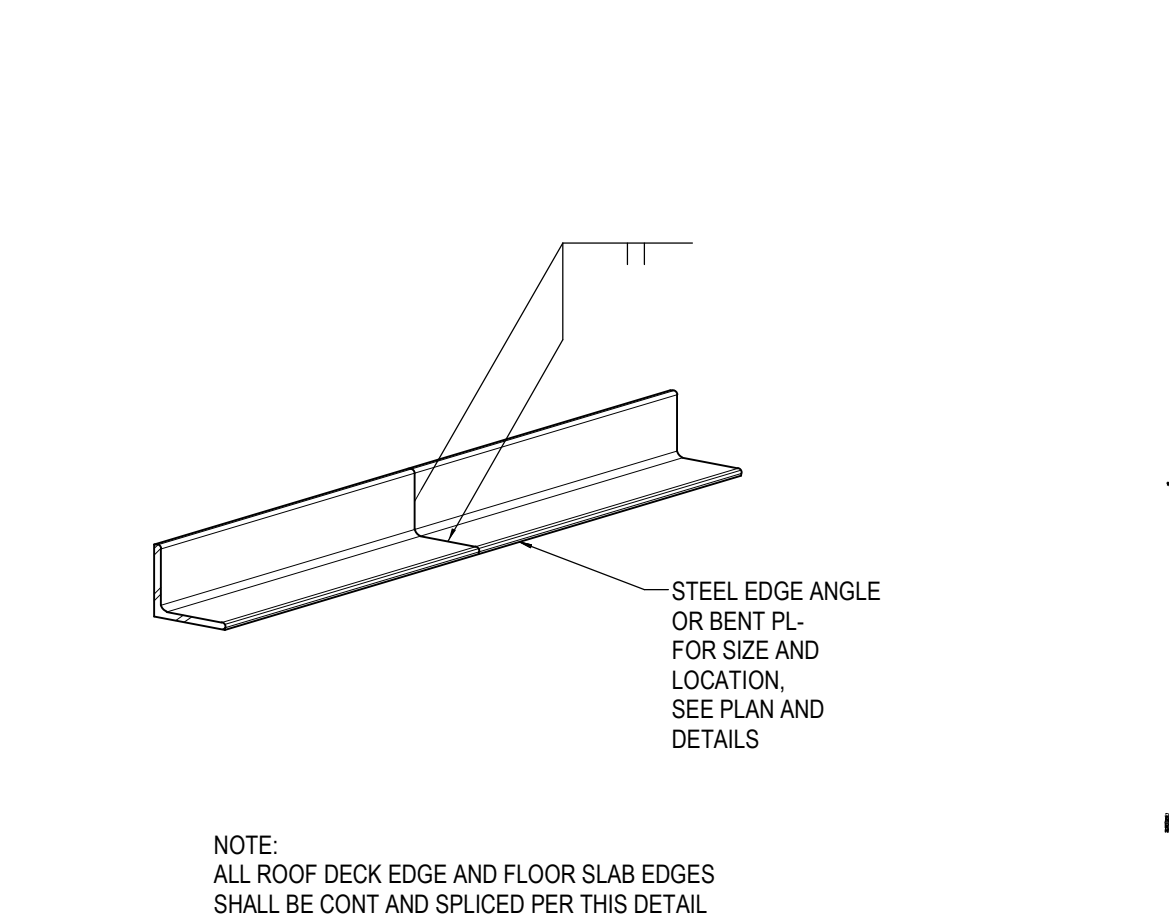

55 BAR TO PLATE WELD SCHEDULE
SCALE: 3" = 1'-0"

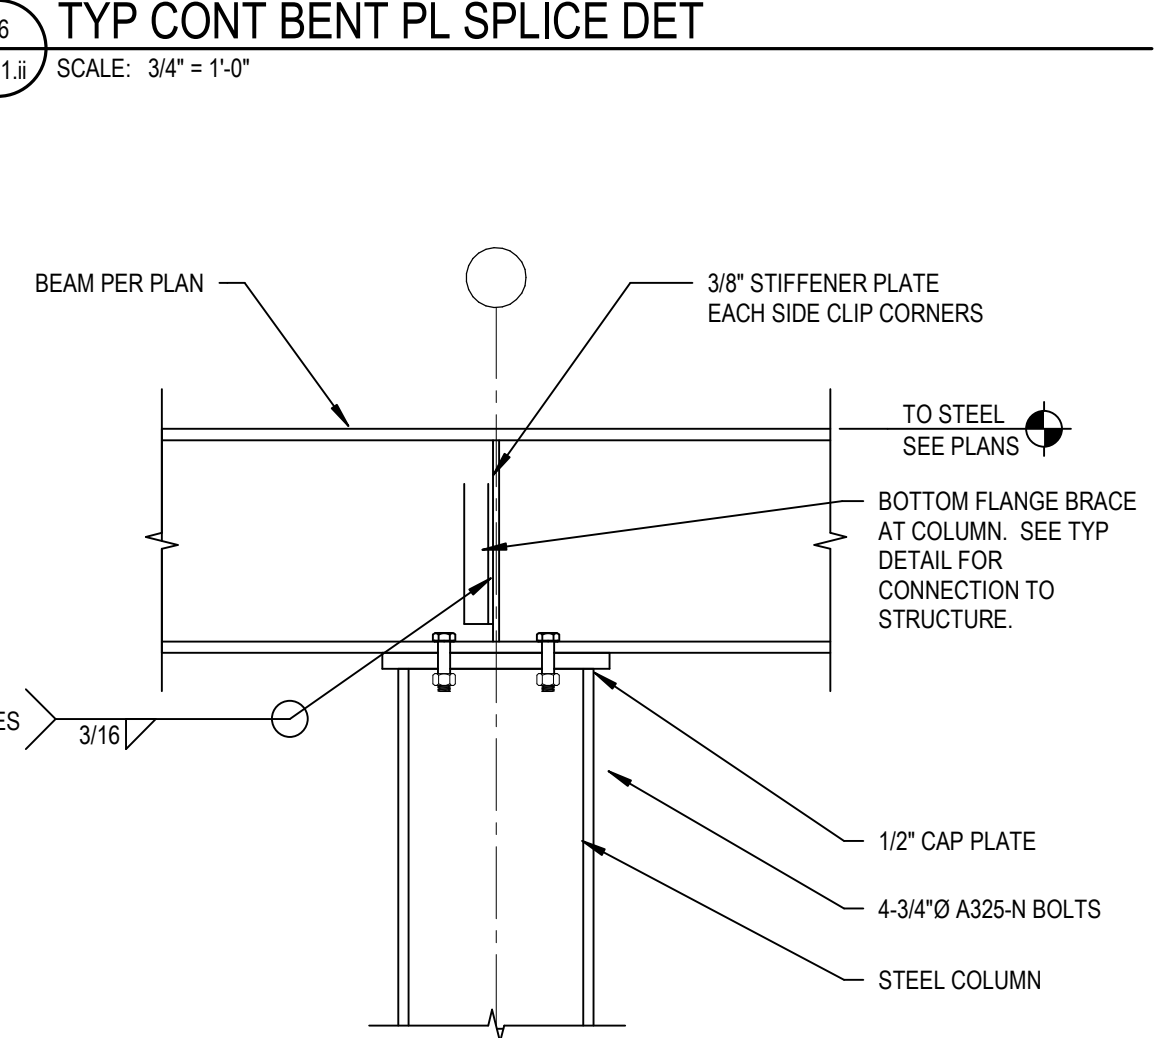

56 WELD PARALLEL TO BAR SCHED
SCALE: 3" = 1'-0"

MARK	SIZE	BASE PLATE TYPE	BASE PLATE DIMENSIONS	ANCHOR BOLTS	NOTES
C-1A	W10X33A	BP1	PL1x16x1'-4"	(4) 3/4" Ø F1554 GR 55 (24" EMBED)	
C-1B	W10X33B	BP2	PL1x16x1'-4"	(6) 3/4" Ø F1554 GR 55 (24" EMBED)	
C-2	W12x58	BP2	PL1x16x1'-4"	(6) 3/4" Ø F1554 GR 55 (24" EMBED)	
C-3	W12x65	BP4	PL1-1/2x16x1'-4"	(4) 1-1/4" Ø F1554 GR 55 (24" EMBED)	
C-4	HSS8x3/8	BP3	SEE DETAIL 34/S3.2	SEE DETAIL 34/S3.2	
C-5	HSS5x1/4	BP3	PL1/2x7x1'-0"	(6) 1/2" Ø HSA (14" EMBED)	

STEEL COLUMN SCHEDULE

BAR SIZE	WELD SIZE (IN)	MIN PLATE THICKNESS (IN)
3	1/4	5/16
4	5/16	5/16
5	3/8	5/16
6	7/16	3/8
7	1/2	1/2
8	9/16	1/2
9	5/8	5/8
10	11/16	5/8
11	3/4	3/4

GRADE 60 BAR (A706)

BAR SIZE	PL THICKNESS (IN)	MINIMUM LENGTH OF WELD (IN)	MIN SPLICE LENGTH (IN)
E70	3	1 1/2	1 1/2
	4	2	2
	5	2 1/2	2 1/2
	6	3	3
	7	3 3/4	3 1/4
	8	5	4
E70	9	6 1/4	5
	10	8	6 1/4
	11	9 3/4	7 3/4

ELECTRODE

DLR Group
© DLR Group

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed Design Professional, to alter an item in any way.

REBID DUTCHESS STADIUM NEW LEFT FIELD CLUBHOUSE, SEATING BOWL, & RESTROOM BUILDING
OWNER: DUTCHESS COUNTY, 22 MARKET STREET POUGHKEEPSIE, NY 12601
1500 ROUTE 90, FISHKILL, NY 12520

BID SET 11.04.22 REVISIONS 1 CONSTRUCTION DOCS 03.06.23 2 ASI 02 04.27.23

57-21113-00 ROOF FRAMING TYPICAL DETAILS

S5.1.ii