




CITY OF NEW YORK  
 DEPARTMENT OF ENVIRONMENTAL PROTECTION  
**STANDARD FOR TYPE 2 CATCH BASIN**  
 (WITHOUT CURB PIECE)

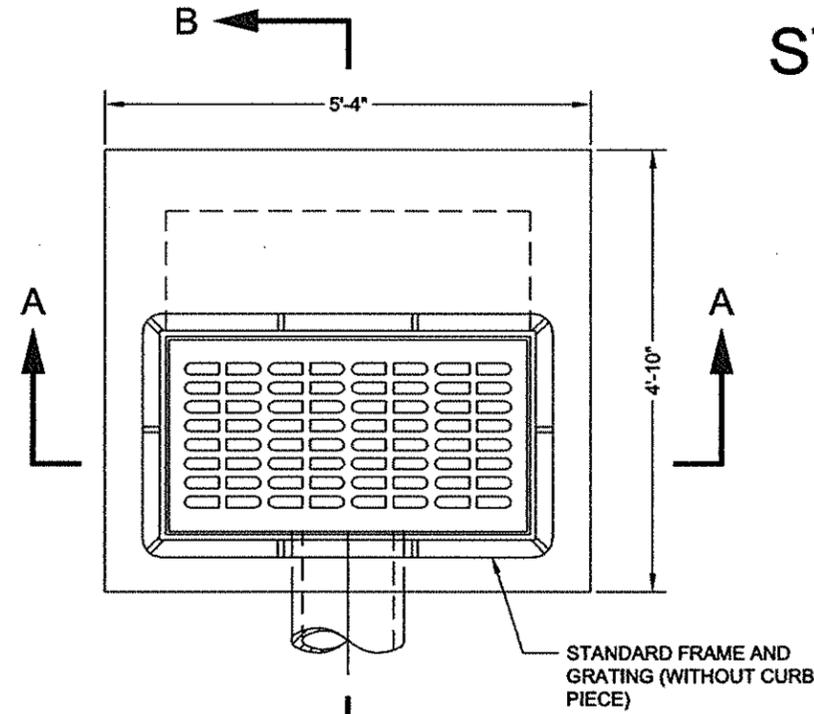


PLAN  
(WITH CASTING)

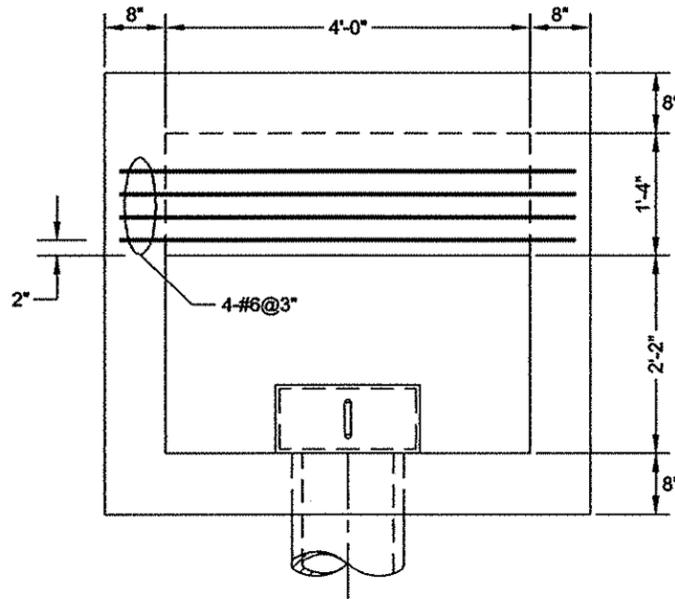

PLAN  
(WITHOUT CASTING)

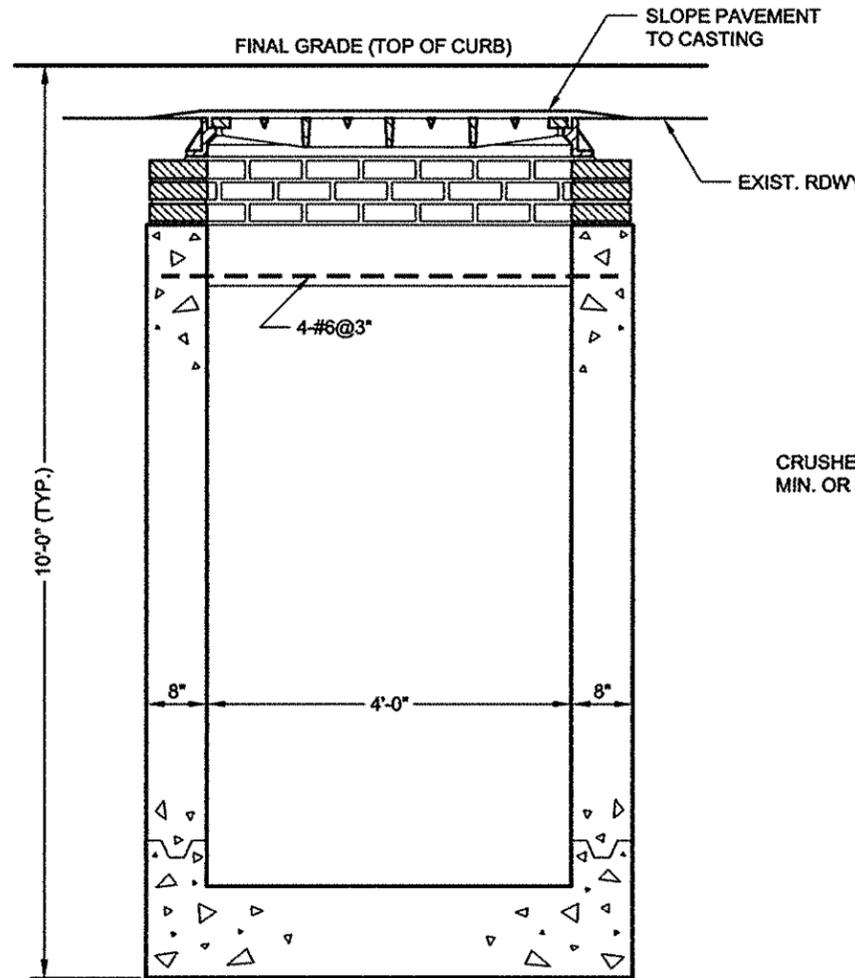

SECTION A-A

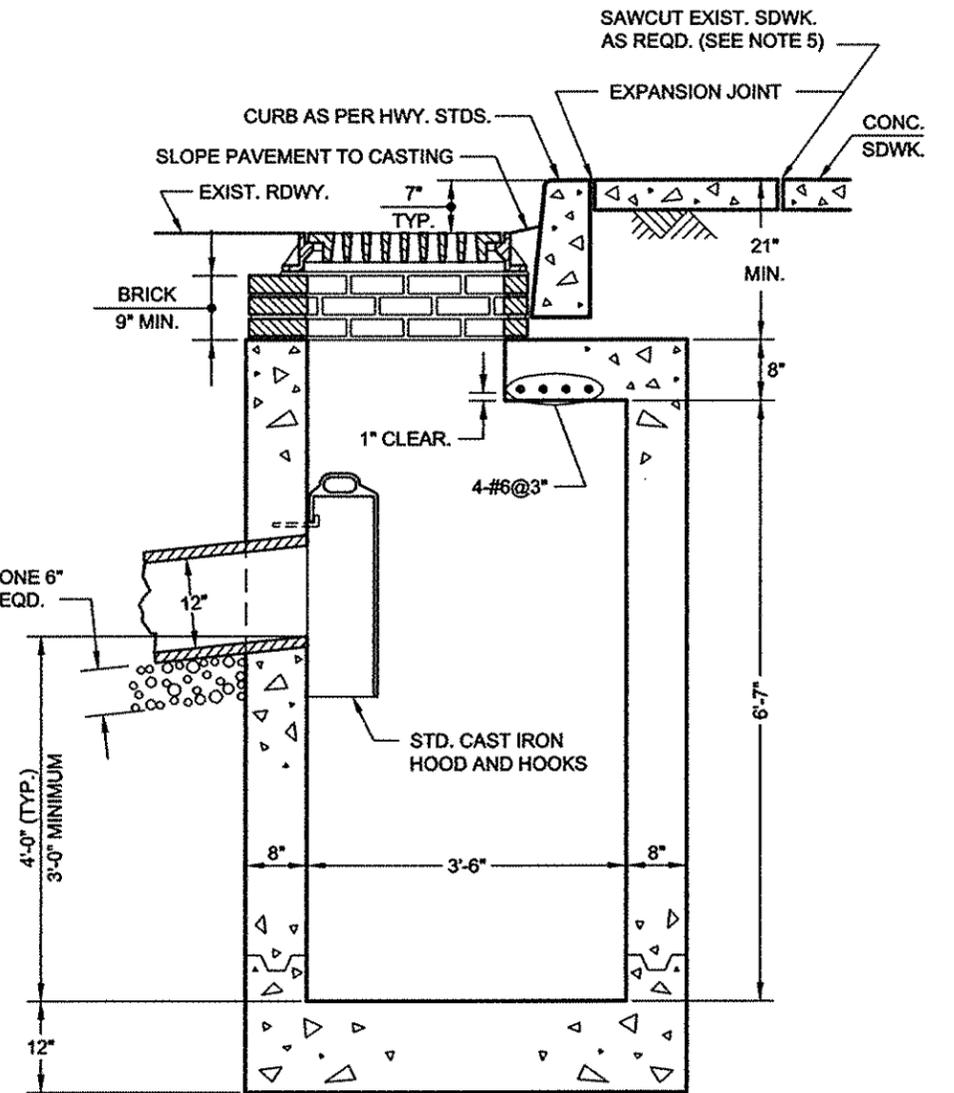

SECTION B-B

**NOTES:**

- (1) LOCATION OF CURB SHALL BE AS SHOWN UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
- (2) LOCATION AND ANGLE OF BASIN CONNECTION MAY BE VARIED TO SUIT FIELD CONDITIONS.
- (3) KEYED CONSTRUCTION JOINTS ARE REQUIRED BETWEEN ANY SUCCESSIVE POURS.
- (4) THE MINIMUM DROP FROM BASIN TO SEWER SHALL BE 6".
- (5) EXPANSION JOINTS ARE REQUIRED IN THE CONCRETE SIDEWALK AREA AT A DISTANCE OF 1'-0" AROUND THE PERIMETER OF THE BASIN.
- (6) CONCRETE IS TO BE CLASS 40. REBARS-GRADE 60.
- (7) COVER FOR ALL REINFORCEMENT IS 2" CLEARANCE UNLESS OTHERWISE SPECIFIED.

*Gandip S. Saini*  
 P.E.  
 ASSOCIATE COMMISSIONER, DESIGN  
 DEPARTMENT OF DESIGN AND CONSTRUCTION

8/14/18  
 DATE

*Thomas Wynne*  
 P.E.  
 EXECUTIVE DIRECTOR OF ENGINEERING  
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

8/14/18  
 DATE