



TO: Brian T. Dunn, AIA KG+D Architects, PC 285 Main Street Mount Kisco, NY 10549	FROM: LJ Coppola	
PROJECT: Harrison, Town-Village Recreation Center Phase 2 270 Harrison Avenue Harrison, NY 10528	ISSUE DATE: 2/17/2025	RFI No. 004 #037
PROJECT NUMBERS: 2020-1005 /	REQUESTED REPLY DATE: COPIES TO:	

See Attached

SPECIFICATIONS: See Attached **DRAWINGS:** See Attached **OTHER:** See Attached

SENDER'S RECOMMENDATION: *(If RFI concerns a site or construction condition, the sender may provide a recommended solution, including cost and/or schedule considerations.)*

RECEIVER'S REPLY: *(Provide answer to RFI, including cost and/or schedule considerations.)*

Phil Pignatelli

February 17, 2025

BY

DATE _____


COP|ES TO

Note: This is a **Minor Change** in the work. No additional cost, time or both. If any reply requires a change to the Contract Documents, a Change Order, corrective or a Minor Change in the work must be executed in accordance with the Contract Documents.

OLA Response 02-19-2025:

Glycol mixing unit shall feed into expansion tank piping and not air separator. Provide shutoff valve.

Provide 1/2" CW from nearest 3" CW pipe downstream of BFP for makeup water. Provide shutoff valve.

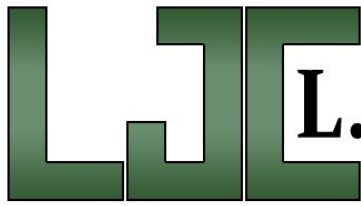

L.J. COPPOLA INC.

MECHANICAL CONTRACTORS

40 Farrington Road
Brewster, NY 10509
(914) 769-7666
Fax: (914) 769-5141
Plumbing License No. 750

PLUMBING

H.V.A.C.

PROCESS PIPING

SEWAGE TREATMENT

ESTABLISHED 1972

REQUEST FOR INFORMATION

Project: HARRISON REC CENTER PHASE 2 **Date:** 2/14/25 **Log No.:** LJC# -05

Drwg.: N/A **Spec.:** N/A **Area:** MER

Directed To: PIAZZA BROTHERS **Date Required:**

Impact: N/A

Regarding: GLYCOL MIXING UNIT MAKEUP WATER

REQUESTED BY: LJC **cc:**

INFORMATION REQUIRED:

Please confirm that the glycol mixing unit is intended to feed into the top of the air separator, as indicated on M-501.

Please also clarify how makeup water is to be provided to GMU-1.

RESPONSE:

RESPONSE BY:

RESPONSE DATE: **cc:**

Your response is requested by the date listed above. Failure to respond by this date may delay the project schedule and may have a cost impact.